


**SCHEMATIC LAYOUT FOR PROVISION OF SPEECH & DATA THROUGH OPGW APPLICABLE TO  
220KV BHANJANAGAR-MERAMUNDALI LILO AT DASAPALLA**

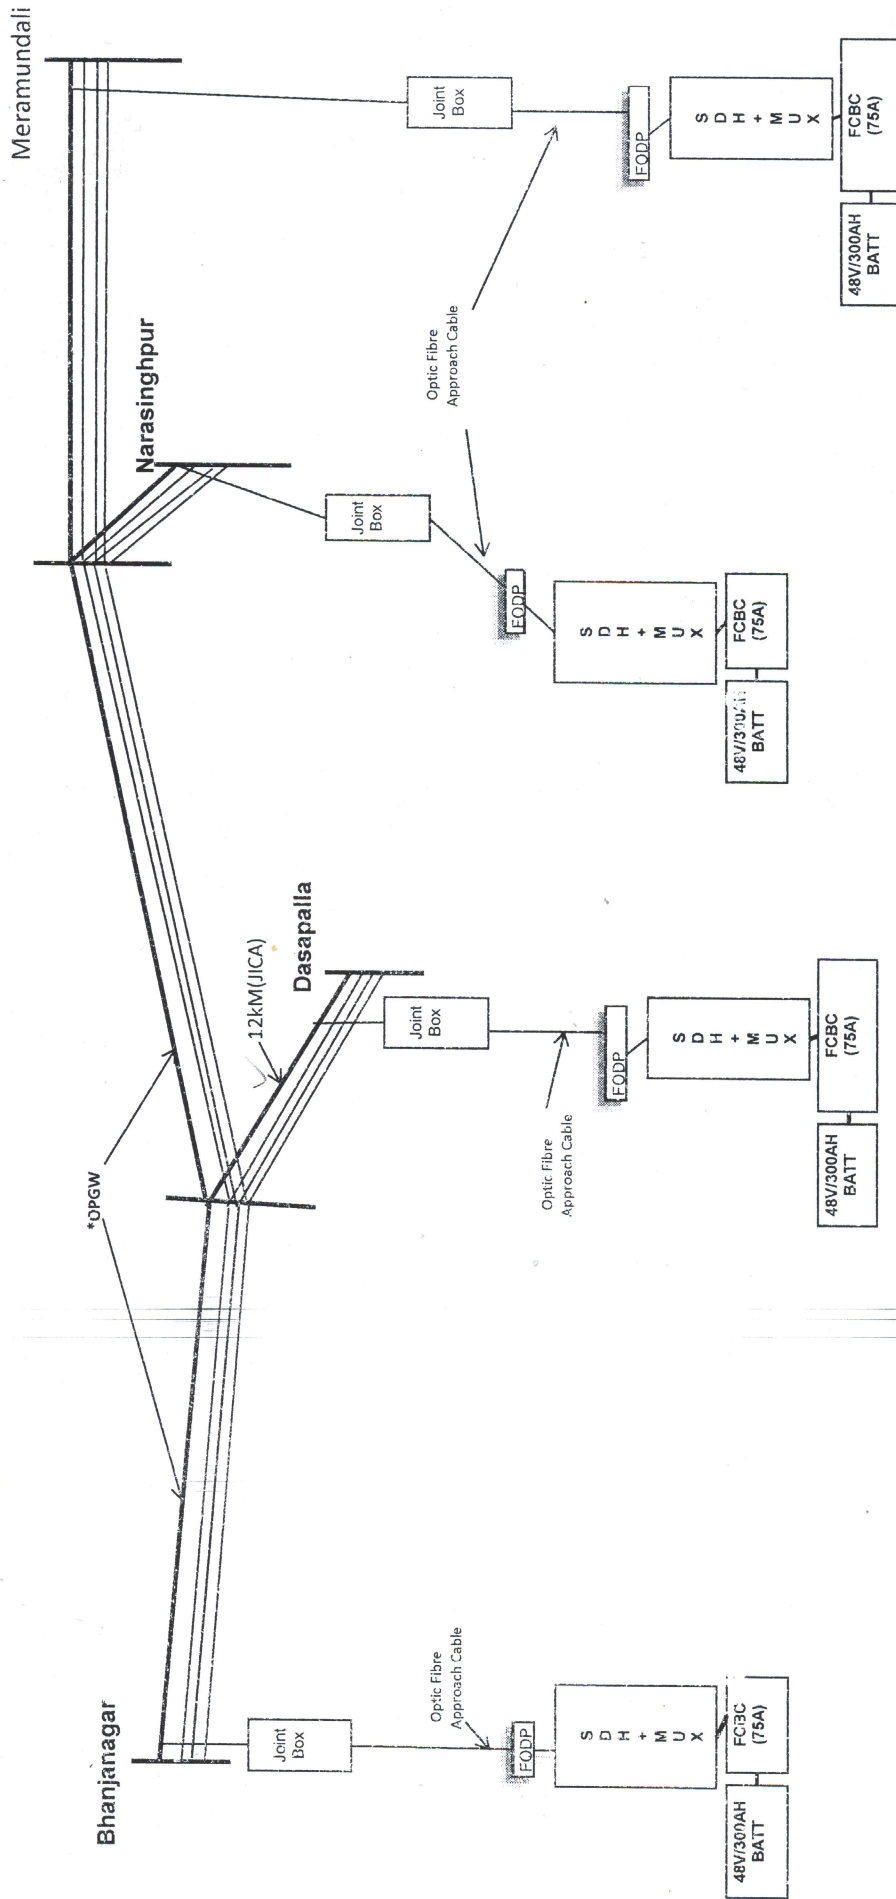

**NB:**  
 1) OPGW ALONG WITH OLTE IS EXISTING AT MERAMUNDALI S/S.  
 2) OLTE IS PROPOSED AT BHANJANAGAR IN 132KV OPGW SCHEME.  
 3) OPGW ALONG WITH OLTE HAS BEEN PROPOSED FOR BHANJANAGR-MERAMUNDALI LINE AND LILO S/S AT NARASINGHPUR

*Santosh*  
 CHIEF GENERAL MANAGER  
 TELECOMMUNICATION