



Mob-9438907686

**ODISHA POWER TRANSMISSION CORPORATION LIMITED**

**OFFICE OF THE DEPUTY GENERAL MANAGER: ELECTRICAL**

**EHT (O&M) DIVISION, BHANJANAGAR,**

**AT: KANTEIPALLI, POST: BADAPADA, DIST: GANJAM (ODISHA), PIN: 761 124**

**E-mail - ehtm.div.bnj@optcl.co.in GSTIN: 21AAAC07873L1Z6**

No. TW-5/Vol-7/ 135

Date: 22.02.2018

**Addendum/Corrigendum-2 to Tender Notice 08/2017-18**

**SUPPLY OF 4 NOS OF 415 V, 3 PHASE, 4 WIRE OUTDOOR ACDB  
CONSOLE BOX FOR GRID S/S ASKA UNDER EHT (O&M) DIVISION, BHANJANAGAR**

**THE FOLLOWINGS MODIFICATIONS ARE THE MADE IN THE TENDER SPECIFICATION**


Description	Existing	Revised
Dimension of ACDB console box in Section—III	Not mentioned	Enclosed Drawing with dimensions (attached)
Single line diagram of 132 KV ACDB console	Drawing with 10 A fuses (2 Pole)	Revised drawing attached

DESCRIPTION (TECHNICAL SPECIFICATION)			Existing	Amended
HRC fuse base with carrier (20 A, 550 V AC)	(A) 132 KV console box at sl. no.	10	200 nos	60 nos
HRC fuse (6 A)		11	120 nos	60 nos
Neutral links with base and carrier (15 A)		12	200 nos	24 nos
HRC fuse base with carrier (20 A, 550 V AC)	(B) 33 KV console box at sl. no.	9	200 nos	54 nos
HRC fuse (6 A)		10	120 nos	54 nos
Neutral links with base and carrier (15 A)		11	200 nos	18 nos

**N:B- All other terms & condition of the tender notice/specification remains unaltered.**


  
Dy. General Manager (Elect.)  
EHT (O&M) Division, Bhanjanagar

# BOTH FOR 132 KV & 33 KV CONSOLE PANEL DIMENSION

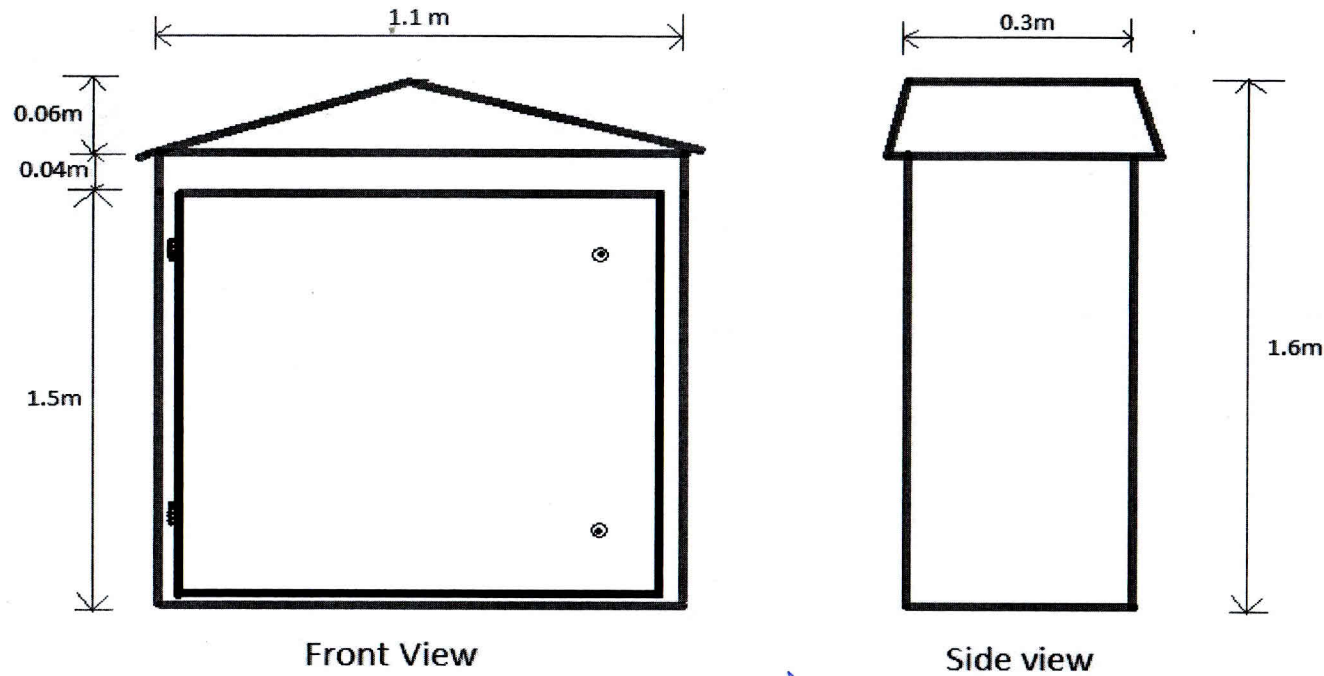

*Handwritten signature*  
22/02/18  
Deputy General Manager (Elec.)  
EHT (O & M) Division, OPTCL  
Bhanianagar  
*Handwritten initials*

# SINGLE LINE DIAGRAM OF ACDB PANEL FOR 132 KV SWITCHYARD

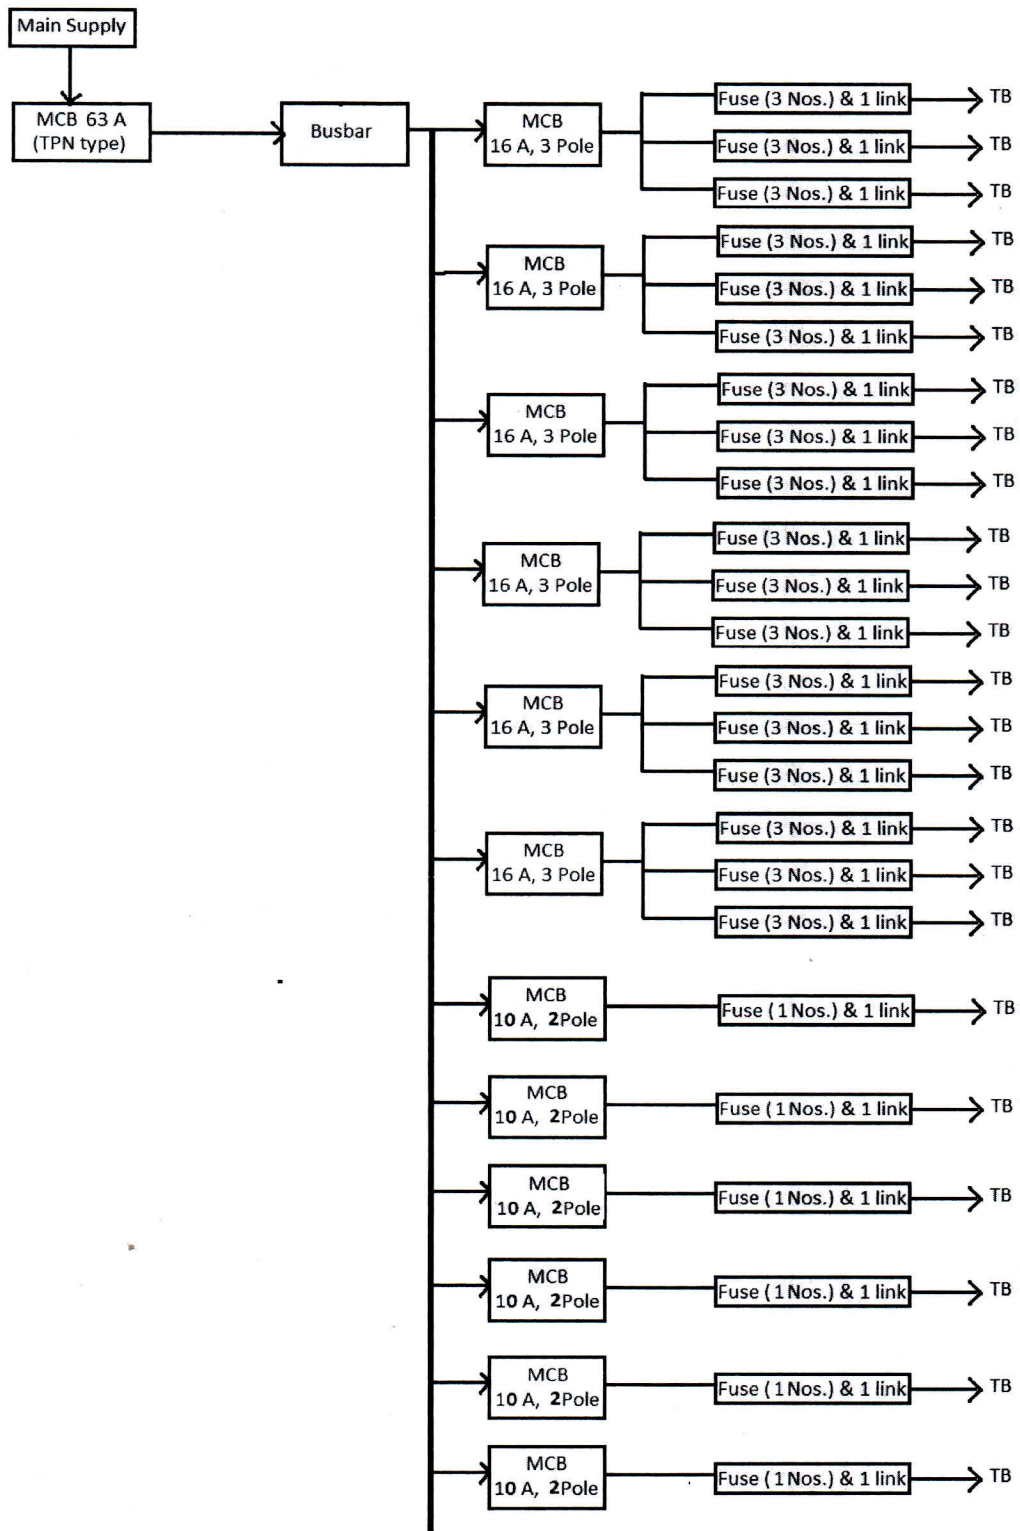

*[Signature]*  
22/02/18  
Deputy General Manager (Elec.),  
EPT (O & M) Division, OPTCL,  
Bhanjanagar