



**ODISHA POWER TRANSMISSION CORPORATION LTD
OFFICE OF THE CHIEF GENERAL MANAGER,
TELECOMMUNICATION, MULTI-STOREYED BUILDING
JANPATH, BHUBANESWAR – 751022**

TENDER SPECIFICATION

NO. CGM (Tel)- e-TENDER-Telecom-OPGW-07/2025-26

**FOR
Procurement of 48F/ 24F OPGW Cable.**

(E tendering mode only)

S1	ITEM DESCRIPTION	UNIT	Quantity
(i)	24Fibre(DWDM) OPGW fibre optic Cable	Km	74.555
(ii)	48Fibre(DWDM) OPGW fibre optic Cable	Km	108.5

Request for online tender documents – From dt-18.02.2026 (11.00 AM) to dt-10.03.2026 (12.45 PM)

Last date of submission of online tender - dt-10.03.2026 (1.00 PM)

Date of opening of Tender - 11.03.2026 (01.00 PM)

ODISHA POWER TRANSMISSION CORPORATION LTD.

REGD. OFFICE: JANPATH, BHUBANESWAR – 751 007,

ODISHA

e-TENDER NOTICE NO. CGM (Telecom)-07/2025-26

For and on behalf of ODISHA POWER TRANSMISSION CORPORATION LTD, Chief General Manager [Telecom] invites Tenders from reputed manufacturers in two part bidding system for Supply of 48F/ 24F OPGW Fibre. The interested bidders would be required to enroll themselves on the tender portal www.tenderwizard.com/OPTCL. Complete set of bidding documents are available at www.tenderwizard.com/OPTCL from **18.02.2026 (11.00 AM) to dt-10.03.2026 (12.45 PM)**. Interested manufacturers may visit OPTCL's official web site <http://www.optcl.co.in> and www.tenderwizard.com/OPTCL for detail specification.

N.B:-All subsequent addendums / corrigendum to the tender shall be hosted in the OPTCL's official web site <http://www.optcl.co.in> and www.tenderwizard.com/OPTCL only.

CHIEF GENERAL MANAGER [Telecom] I/c

NOTICE INVITING TENDER
ODISHA POWER TRANSMISSION CORPORATION LTD.,
REGD. OFFICE: JANPATH, Bhubaneswar.

e-TENDER NOTICE NO- CGM (Telecom)-07/2025-26.

For and on behalf of the ODISHA POWER TRANSMISSION CORPORATION LTD., the undersigned invites bids under two-part bidding system in e- tendering mode only as per the following details.

Sl. No	Tender Specification No.	Description of equipment/materials	Quantity In km	Delivery schedule.	Earnest Money Deposit (In Rs.)	Cost of Tender document (in Rs.)	Last date of receipt & opening of tender
1.	CGM (Tel)- e-TENDER- Telecom- OPGW- 07/2025-26	24Fibre(DWSM) OPGW fibre optic Cable	74.555	(As per Appendix-II of technical specification)	4,39,069/-	12,000/- + 2160/- (GST) =14,160/-	10.03.2026 (01.00 PM) & 11.03.2026 (01.00 PM)
2.		48Fibre(DWSM) OPGW fibre optic Cable	108.5				

The bidders can view the tender documents from website free of cost.

TENDER COST:

The bidders who want to submit bid shall have to pay Rs. 14,160/- (Rupees Fourteen thousand one hundred sixty) only non-refundable including GST @ 18% towards the tender cost, **as per tender notice online through e-payment gateway link provided in e-tender portal (by using Net Banking, Debit Card or Credit Card) prior to last date & time of submission of online tender.** They have to also submit notarized hard copy of GST registration certificate on or before the scheduled date & time of opening of techno-commercial bid.

TENDER PROCESSING FEE:

The bidders shall have to submit non-refundable amount of Rs.5,900/- (Rupees Five Thousand Nine Hundred) only including GST @ 18% towards the tender processing fee to K.S.E.D.C. Ltd, in e-payment mode. The e-payment of above amount is to be made to enable the bidder to down load the bid proposal sheets & bid document in electronic mode.

SUBMISSION OF TENDER COST, TENDER PROCESSING FEE & EMD:

The bidder shall deposit the tender cost, tender processing fee & e-BG prior to last date & time for submission of bid as notified in tender notice. Local micro & small enterprisers (MSEs) **(In the state of Odisha)** based in Odisha and registered with respective DICs, Khadi, Village, Cottage & Handicrafts Industries, OSIC and NSIC can participate without payment of the cost of tender specification. They have to submit notarized hard copy of valid registration as local MSE **(In the state of Odisha)** as above on or before the date & time of submission of techno-commercial bid.

The copy of tender cost, processing fees are to be submitted along with the e-BG at the office of the undersigned on or before the last date & time of submission of tender.

The prospective bidders are advised to register their user ID, Password, company ID from website www.tenderwizard.com/OPTCL by clicking on hyper link "Register Me".

Any clarifications regarding the scope of work and technical features of the tender can be had from the undersigned during office hours.

Minimum qualification criteria of bidders: AS STIPULATED IN SECTION-II, (G.T.C.C) OF THE TENDER SPECIFICATION.

CHIEF GENERAL MANAGER (Telecom) I/c

ODISHA POWER TRANSMISSION CORPORATION LTD.

OFFICE OF THE CHIEF GENERAL MANAGER (TELECOM)

TELEPHONE NO.:0674 – 2542403

BHOI NAGAR, JANAPATH, BHUBANESWAR – 751022

TENDER SPECIFICATION NO. CGM (Tel)- e-TENDER-Telecom-OPGW-07/2025-26

CONTAINING

PART – I

SECTION – I : INSTRUCTION TO TENDERERS

**SECTION – II : GENERAL TERMS AND CONDITIONS OF
CONTRACT (G.T.C.C.) (COMMERCIAL)**

SECTION – III : LIST OF ANNEXURES (COMMERCIAL)

SECTION – IV : TECHNICAL SPECIFICATION

PART – II PRICE BID.

PART – I

SECTION – I

INSTRUCTIONS TO TENDERERS

<u>Clause.</u>	<u>Title.</u>	<u>Page.</u>
1.	Submission of Bids.	07
2.	Division of Specification.	08
3.	Tenders shall be in two parts.	08
4.	Opening of Bids.	08
5.	Purchaser's right regarding alteration in Quantities, Tendered.	09
6.	Procedure and opening time of tenders.	09
7.	Bidder's liberty to deviate from specification.	09
8.	Eligibility for submission of bids.	10
9.	Purchaser's right to accept/reject bids.	10
10.	Mode of submission of tenders.	10
11.	Earnest money deposit.	10
12.	Incorporation of Mandatory Electronic Bank Guarantee (e-BG) through NeSL Platform in Tender Specification.	11
13.	Validity of the bids.	12
14.	Price.	12
15.	Revision of Tender Price by Bidders.	12
16.	Tenderers to be fully conversant with the clauses of the Specification.	12
17.	Documents to accompany Bids.	12
18.	Documents/Papers to Accompany PART – II Bid.	13
19.	Conditional Offer.	13
20.	General.	13

COMMERCIAL SPECIFICATION
SECTION-I
INSTRUCTIONS TO TENDERER

1. 1. Submission of Bids: -

The bidder shall submit the bid in Electronic Mode only i.e. www.tenderwizard.com/OPTCL. The bidder must ensure that the bids are received in the specified website of the OPTCL by the date and time indicated in the Tender notice. Bids submitted by telex/telegram will not be accepted. No request from any bidder to the OPTCL to collect the Bids in physical form will be entertained by the OPTCL.

The OPTCL reserves the right to reject any bid, which is not deposited according to the instruction, stipulated above. The participants to the tender should be registered under GST laws.

1. For all the users it is mandatory to procure the Digital Signatures.
2. Contractors / Vendors / Bidders / Suppliers are requested to follow the below steps for

Registration:

- a. Click "Register", fill the online registration form.
 - b. Pay the amount of **Rs. 2360/-** through e-payment ~~DD~~ in Favour of KSEDCL Payable at Bangalore.
 - c. Send the acknowledgment copy for verification.
 - d. As soon as the verification is being done the e-tender user id will be enabled.
3. After viewing Tender Notification, if bidder intends to participate in tender, he has to use his e-tendering User Id and Password which has been received after registration and acquisition of DSCs.
 4. If any Bidder wants to participate in the tender he will have to follow the instructions given below:
 - a. Insert the PKI (which consist of your Digital Signature Certificate) in your System. (Note: Make sure that necessary software of PKI be installed in your system).
 - b. Click / Double Click to open the Microsoft Internet Explorer (This icon will be located on the Desktop of the computer).
 - c. Go to Start > Programs > Internet Explorer.
 - d. Type **www.tenderwizard.com/OPTCL** in the address bar, to access the Login Screen.
 - e. Enter e-tender User Id and Password, click on "Go".
 - f. Click on "Click here to login" for selecting the Digital Signature Certificate.
 - g. Select the Certificate and enter DSC Password.
 - h. Re-enter the e-Procurement User Id Password
 5. To make a request for Tender Document Bidders will have to follow below mentioned steps.
 - Click "Un Applied" to view / apply for new tenders.

- Click on Request icon for online request.
6. After making the request Bidders will receive the Tender Documents which can be checked and downloaded by following the below steps:
 - Click to view the tender documents which are received by the user.
 - Tender document screen appears.
 - Click “Click here to download” to download the documents.
 7. After completing all the formalities Bidders will have to submit the tender and they must take care of following instructions.
 - Prior to submission, verify whether all the required documents have been attached and uploaded to the particular tender or not.
 - Note down / take a print of bid control number once it displayed on the screen
 8. Tender Opening event can be viewed online.
 9. Competitors bid sheets are available in the website for all.
 10. **For any e-tendering assistant contact help desk number mentioned below.**
Bangalore – 080- 40482000.

The participants to the tender should be registered under GST laws.

2. Division of Specification.

The specification is mainly divided into two parts viz. Part-I & Part-II.

Part-I Consists of

- | | |
|-------------------|-----------------------------------------|
| [i] Section-I | Instruction to Tenderers. |
| [ii] Section-II | General Terms & conditions of contract. |
| [iii] Section-III | Schedules and forms etc. |
| [iv] Section-IV | Technical Specification. |

Part-II Consists of

Schedule of prices as per Annexure-V

3. Tenders shall be in two parts.

The Tenderers are required to submit the tenders in two parts viz. Part-I (Techno commercial) & Part-II (Price bid).

4. Opening of Bids.

- [a] The Part-I of tender shall be opened on the date and time fixed by the OPTCL for opening of bids in Electronic mode in presence of such of the Tenderers or their authorized representatives [limited to one person only] on the due date of opening of tender who opt remain present. After scrutiny of the technical particulars and other commercial terms, clarifications, if required, shall be sought for from the bidders. The Tenderers shall be allowed 15 days time for such activity.
- [b] On receipt of technical clarification, the bids shall be reviewed, evaluated and those not in conformity with the technical Specification / qualifying experience, shall be rejected. If

any of the technical proposal requires modification to make them comparable, discussion will be held with the participating bidders.

All the responsive bidders shall be given opportunity to submit the revised technical and revised price proposals as a follow up to the clarification (modification if any) on the technical proposals. The qualified bidders shall be given opportunity to submit revised price proposals within 15 days from the date of such discussion or within time frame mutually agreed, whichever is earlier.

- [c] When the revised price proposals are received, the original price proposals will be returned to the bidders unopened along with their original technical proposals. Only the revised technical and price proposals will be considered for bid evaluation. The price bids [Part-II] of such of the Tenderers, whose tenders have been found to be technically and commercially acceptable, including those supplementary revised price bids, submitted subsequently, shall be opened in the presence of the bidder's representative on a date and time which will be intimated to all technically and commercially acceptable Tenderers.
 - [d] The bidders are required to furnish sufficient information to the Purchaser to establish their qualification, capacity to manufacture and/or supply the materials/perform the work. Such information shall include details of bidder's experience, its financial, managerial and technical capabilities.
 - [e] The bidders are also required to furnish details of availability of appropriate technical staff and capability to perform after sales services. The above information shall be considered during scrutiny and evaluation of bids and any bid which does not satisfactorily meet these requirements, shall not be considered for price bid evaluation.
 - [f] The price bids of the technically and otherwise acceptable bids shall only be evaluated as per the norms applicable in terms of this Specification.
5. **Purchaser's Right Regarding Alteration of Quantities Tendered.**
The Purchaser may alter the quantities of materials/equipment at the time of placing orders. Initially the purchaser may place orders for lesser quantity with full freedom to place extension orders for further quantity under similar terms and conditions of the original orders. Orders may also be split among more than one tenderer for any particular item, if considered necessary in the interest of the Purchaser to get the goods/equipment earlier.
6. **Procedure and opening time of tenders.**
Tenders will be opened in the office of the Chief General Manager [Telecom] on the specified date and time in presence of the Tenderers or their authorized representatives [limited to one person only] in case of each bidder who may desire to be present, at the time of opening the bids.
7. **Bidder's Liberty to deviate from Specification.**
The Tenderer may deviate from the specification while quoting, if in his opinion, such deviation is in line with the manufacturer's standard practice and conducive to a better and

more economical offer. All such deviations should however be clearly indicated giving full justifications for such deviation. [Read with Clause-9, Section-II of the Specification].

8. Eligibility for submission of bids.

Only those manufacturers who have deposited the cost of tender specification are eligible to participate in the tender. They should submit the money receipt as a proof of such payment. The local Micro and small Enterprises (MSEs) (In the state of Odisha) registered with respective DICs, Khadi, Village, Cottage & Handicrafts Industries, OSIC and NSIC can participate without payment of the cost of tender specification.

9. Purchaser's right to accept/reject bids:

The purchaser reserves the right to reject any or all the tenders without assigning any reasons what so ever if it is in the interest of OPTCL, under the existing circumstances. [Read with clause-10, Section-II of the specification].

10. Mode of submission of Tenders.

[A] Tenders shall be submitted in electronic mode only. (www.tenderwizard.com/OPTCL)

[B] Telegraphic or FAX tenders shall not be accepted under any circumstances.

11. Earnest money deposit:

The tender shall be accompanied by Earnest Money deposit of value specified in the notice inviting tenders against each lot / bid. Tenders without the required EMD as indicated at Annexure-VIII will be rejected out rightly.

The local Micro and small Enterprises(MSEs) (In the state of Odisha)registered with respective DICs, Khadi, Village, Cottage & Handicrafts Industries, OSIC and NSIC can participate by submitting Earnest Money Deposit @ fifty percent of the amount indicated in the Notice Inviting Tender.

The earnest money deposit shall be furnished in one of the following forms subject to the conditions mentioned below:

(a) ~~Cash: Payable to drawing & disbursing Officer, OPTCL (Hd.qrs. Office), Bhubaneswar 751022~~

(b) ~~Bank Draft: To be drawn in favour of Drawing & Disbursing Officer, OPTCL [H.Qrs.Office], Bhubaneswar 751 022.~~

(c) The e-BG is issued by any Scheduled Commercial Bank listed on NeSL platform and is delivered electronically to the OPTCL's official NeSL account : Name of the Organization/ Beneficiary : Odisha Power Transmission Corporation Limited, NeSL ID: AAACO7873L.

NOTE:

(i) The validity of the EMD in the form of Bank Guarantee shall be at least for 240 days from the date of opening of tender failing which the tender will be liable for rejection.

(ii) No interest shall be paid on the Earnest Money Deposit.

~~(iii) E.M.D. in shape of cash may be submitted up to Rs. 25,000/- (Rupees Twenty five) Thousand) only. Above Rs. 25,000/- (Rupees Twenty five thousand) the Earnest Money~~

~~Deposit shall be furnished in any one of the forms indicated above (i.e. Through Bank Draft, Bank Guarantee/ National Savings Certificate).~~

- (iv) No adjustment towards EMD shall be permitted against any outstanding amount with the **ODISHA POWER TRANSMISSION CORPORATION LTD.**
- (v) The chart showing particulars of EMD to be furnished by Tenderers of different categories is placed at **Annexure-VIII.**
- (vi) In the case of un- successful tenderer, the EMD will be refunded after the tender is decided. In the case of successful Tenderer, this will be refunded only after furnishing of security money referred to at clause-19 of Section-II.
- (vii) Suits, if any, arising out of this clause shall be filed in a Court of law to which the jurisdiction of High Court of ODISHA extends.
- (vii) EMD will be forfeited if the tenderer fails to accept the letter of intent and/or purchase order issued in his favour or to execute the order, placed on them.
- (viii) Tenders not accompanied by Earnest Money shall be disqualified.

12. Incorporation of Mandatory Electronic Bank Guarantee (e-BG) through NeSL Platform in Tender Specification.

- All Bank Guarantees required under this Tender, namely (a) Bid Security (Earnest money Deposit) (b) Performance Security (c) Security against Advance Payment shall be submitted only in the form of Electronic Bank Guarantee (e-BG) issued through National E-Governance Services Limited (NeSL) platform.
- Physical/Paper Bank Guarantees will not be accepted. Any Bid submitted with Physical BG shall be treated as non-responsive and rejected.
- The Bidder shall ensure that the e-BG is issued by any Scheduled Commercial Bank listed on NeSL platform and is delivered electronically to the OPTCL's official NeSL account : Name of the Organization/ Beneficiary : Odisha Power Transmission Corporation Limited, NeSL ID: AAACO7873L
- Procedure for submission:
 - ☐ Bidder / Contractor shall request the issuing bank to create and deliver the e-BG directly to the Employer's (OPTCL) NeSL ID
 - ☐ Upload the e-BG Acknowledgement/Unique Reference Number (URN) against Bid Security / EMD in the Technical bid.
 - ☐ The Employer (OPTCL) will verify the e-BG instantly on NeSL portal.
- Format, Amount and validity of e-BGs shall be strictly as per Tender specification.
- No charges towards stamping, verification or amendment of e-BG shall be borne by the Employer. All such charges shall be borne by the Bidder/Contractor.
- In case of amendment/extension, the Contractor shall submit the amended e-BG through NeSL platform only.
- A copy of the e-BG against Bid Security / EMD must be uploaded online with the bid documents. A copy of e-BG against Bid Security / EMD with Unique Reference Number (URN) shall also be submitted to the office of Chief General Manager, Telecom, OPTCL, Bhubaneswar- on or before scheduled date & time of opening of Tender
- Information of Beneficiary required for issuance of Electronic Bank Guarantee (e-BG)
 - i. Name of Beneficiary's Representative – UMESH KUMAR GUPTA
 - ii. Beneficiary Email ID – cgm.tel@optcl.co.in

- iii. Beneficiary Mobile No. - 9438907259
- iv. Beneficiary PAN / UIN – AAACO7873L
- v. Beneficiary Date of Incorporation/Birth – 29-MAR-2004
- vi. Beneficiary Legal Constitution – ODISHA STATE PUBLIC SECTOR UNDERTAKING
- vii. Platform – NeSL

13. Validity of the Bids: -

The tenders should be kept valid for a period of **180** days from the date of opening of the tender, failing which the tenders will be rejected.

14. PRICE: -

i) Tenderers are requested to quote-‘FIRM’ Price. No deviation from **FIRM PRICE** will be entertained irrespective of deviation clause No.7 of this part of the specification.

15. Revision of tender price by Bidders: -

[a] After opening of tenders and within the validity of period, no reduction or enhancement in price will be entertained. If there is any change in price, the tender shall stand rejected and the EMD deposited shall be forfeited.

[b] After opening of price bid if the validity period is not sufficient to place purchase order, the tenderer may be asked by the purchaser to extend the validity period of the bid under the same terms and condition as per the original tender.

However, the tender are free to change any or all conditions including price except delivery period of their bids at their own risk, if they are asked by the purchaser to extend the validity period of the bid prior to opening of price bid.

16. Tenderers to be fully conversant with the clauses of the Specification: -

Tenderers are expected to be fully conversant with the meaning of all the clauses of the specification before submitting their tenders. In case of doubt regarding the meaning of any clause, the tenderer may seek clarification in writing from the Chief General Manager (Telecom) OPTCL. This, however, does not entitle the Tenderer to ask for time beyond due date, fixed for receipt of tender.

17. Documents to Accompany Bids.

Tenderers are required to submit tenders in the following manner:

The Tender shall Contain the following documents.

- [i] Declaration Form. [As per Annexure-I]
- [ii] Earnest Money. [As per **Annexure-VIII**]
- [iii] Technical specification and Guaranteed Technical Particulars conforming to the Purchaser’s Specification along with drawings, literatures and all other required Annexures, duly filled in.
- [iv] Photostat copies of type test certificates of materials/equipments offered as stipulated in the Technical Specification.
- [v] Abstract of Terms & conditions in prescribed proforma as per **Annexure-II.**
- [vi] General Terms & Conditions of supply offer as per Section-II of the Specification.
- [vii] List of orders executed for similar materials/equipment’s during preceding 2 (two) years indicating the customer’s name, Purchase Order No. & Date, date of supply and date of commissioning etc.
- [viii] Data on past experience **as per Clause-7 of Section-II** of the Specification.

- [ix] Sales tax clearance certificate for the previous year and GST Compliance Rating. The GST Identification Number (GSTIN) under GST Laws and permanent account number [PAN] of the firm under Income tax Act are required.
- [x] Audited Balance sheet & profit loss accounts of the bidder, for past (3) three years.
- [xi] Schedule of quantity and delivery in the prescribed Proforma vide Annexure, as appended.
- [xii] List of Orders in hand to be executed.
- [xiii] Deviation schedule.
- [xiv] The bidder should not have any pending litigation or arbitration with OPTCL with regard to any project or related activity. The bidder should certify/declare the same in unequivocal terms by way of an affidavit duly sworn before a magistrate/notary.

[xv] Notarized hard copy and soft copy of valid registration as local MSE (In the state of Odisha) (if any).

18. Documents/Papers to accompany Part-II Bid.

- (a) Part-II of the tender shall consist of the following
 - (i) Schedule of prices in the prescribed proforma

19. Conditional Offer:

Conditional offer shall not be accepted.

20. General: -

- (i) In the event of discrepancy or arithmetical error in the schedule of price, the decision of the purchaser shall be final and binding on the Tenderer.
- (ii) For evaluation, the price mentioned in words shall be taken if there is any difference in figures and words in the price bid.
- (iii) Notice inviting tender shall form part of this specification.
- (iv) The price bids of the technically and otherwise acceptable bids shall only be evaluated. The EMD of others, if any, shall be returned to the bidders.
- (v) Tenderer can offer any lot or all the lots of the tender, if there are more than one lots. But the tender (bid) must be furnished separately for each lot. **For each lot, the tenderer has to submit Part-I & Part-II of bids separately.**
- (vi) It should be distinctly understood that the price bid shall contain only details/documents relating to price, as outlined in clause-17 mentioned herein above. Inclusion of any of the documents/information etc. shall render the bid liable for rejection.
- (vii) The tenderer must submit the EMD amount, cost of tender document (Form Fee) and Tender processing fee in a sealed cover envelope super-scribing the tender specification number, Tender Notice No & Date of tender clearly on the cover envelope. The said envelope is to be submitted in the office of the purchaser on or before the last date and time of submission of Bids.

21.0 Expenses in respect of OPTCL's representative for witnessing the inspection & testing of the offered equipment/materials at the inspection and testing site.

The testing and inspection of the equipment/ materials at manufacturer works are in the scope of work of the Contractor/Supplier.

OPTCL inspecting officer, on receipt of offer for inspection from the contractor/supplier, proceeds to the manufacturer works to witness the Type/Acceptance/Routine test.

Important:

It is hereby informed to all the bidders that the relevant clauses of the contract specification, pertaining to inspection and testing of equipment/materials, are hereby supplemented with following additional terms and conditions.

The expenses under the following heads, in respect of OPTCL's representative for witnessing the inspection & testing of the offered equipment/materials at the inspection and testing site, shall be borne by the contractor / supplier.

a) Hotel Accommodation:

- I. Single room accommodation in 4 star hotel for the OPTCL inspecting officer of the rank of Assistant General Manager (Grade E-6) and above.
- II. Single room accommodation in 3 star hotel for the OPTCL inspecting officer of the rank below Assistant General Manager (Grade E-6).

N.B.: It is the responsibility of the contractor to arrange the hotel accommodation matching with their inspection and testing schedule, so that the inspecting officer can check-in the hotel one day prior to the date of inspection and check out after the completion of the inspection, subject to availability of the return travel ticket. In case of extended duration of inspection or non-availability of the return travel ticket, Contractor/supplier/manufacturer shall arrange for the extended stay of the inspecting officer in the Hotel accordingly. In case there is no hotel with prescribed standard in and around the place of inspection, the contractor/supplier/manufacturer shall suggest alternative suitable arrangement at the time of offer for inspection, which is subjected to acceptability of OPTCL inspecting officer.

b) Journey of the inspecting officer:

- (i) To and fro travel expenditure from the Head Quarters of the inspecting officer to the place of inspection/testing shall be borne by the contractor/supplier/manufacturer. Journey from the Head Quarters of the inspecting officer to the nearest Air Port by train (1st/Ind A.C) & A/C Taxi then by Air to the place of inspection/testing or to the nearest place of inspection/testing and then by train (1st/Ind A.C) & A/C taxi to the place of inspection/testing shall be arranged by the contractor/supplier/manufacturer.
- (ii) For train journey, inspecting officer of the rank Assistant General Manager and above shall be provided with 1st class AC ticket and inspecting officer below the rank of Assistant General Manager shall be provided with 2nd class AC ticket.
- (iii) The Air-ticket / train-ticket booking/cancellation is the responsibility of the contractor / supplier.
- (iv) Moreover, if during the journey there is an unavoidable necessity for intermediate travel by road/ waterway/sea-route, the contractor/supplier shall provide suitable conveyance to the inspecting officer for travel this stretch of journey or bear the cost towards this. Any such possibilities shall be duly intimated to OPTCL at the time of their offer for inspection.

c) Local Conveyance:

At the place of the inspection/testing, for local journey of the inspecting officer between Hotel and inspection/testing site and or any other places, Air-conditioned four wheeler vehicle in good condition shall be provided by the contractor/supplier/manufacturer.

d) Following points are also to be considered:

- (i) All the above expenses shall be deemed to be included in the bidder's quoted price for that supply item. Bidder shall not be eligible to raise any extra claim in this regard.
- (ii) Contractor/supplier/manufacturer may assume that only in 40% of the inspection and testing offer cases, OPTCL inspecting officer, not below the rank of Assistant General Manager will witness the inspection and testing.

- (iii) In case of inspection and testing of some critical equipment/materials like Power transformers, OPTCL may depute more than one inspecting officer.
- (iv) Contractor/supplier/manufacturer shall judiciously plan the inspection/testing schedule and place of inspection/testing, so that optimum number of inspection/testing and minimum time shall be required to cover all the equipment/materials of the relevant contract package.
- (v) It shall be the responsibility of the Contractor/Supplier to organize the above tour related matters of OPTCL inspecting officer including the matters related to overseas inspection/testing, if any.

22.0 (a). Detailed information on any litigation or arbitration arising out of contract completed or under execution by it over the last five years. A consistent history of litigation by or against the bidder may result in rejection of bid.

22.0 (b). The bidder should not have any pending litigation or arbitration with OPTCL with regard to any project or related activity. The bidder should certify / declare the same in the unequivocal terms by way of an affidavit duly sworn before a magistrate/notary. Bid furnished by the bidder shall not be eligible for consideration if it is not accompanied by the affidavit. Further the bid / LOA/ LOI shall be liable for outright rejection/ cancellation at any stage if any information contrary to the affidavit / declaration is detected.

SECTION – II.
GENERAL TERMS AND CONDITIONS OF CONTRACT [G.T.C.C.]

<u>Clause.</u>	<u>Title.</u>	<u>Page.</u>
1.	Scope of the contract.	18
2.	Definition of terms.	18
3.	Manner of execution.	19
4.	Inspection and testing.	19
5.	Training facilities.	20
6.	Rejection of materials.	20
7.	Experience of bidders.	21
8.	Language and measures.	21
9.	Deviation from Specification.	21
10.	Right to reject/accept any tender.	22
11.	Supplier to inform himself fully.	22
12.	Patent rights etc.	22
13.	Delivery.	22
14.	Despatch Instructions.	23
15.	Supplier's Default Liability.	23
16.	Force Majeure.	23
17.	Extension of Time.	24
18.	Guarantee Period.	24
19.	Bank Guarantee towards Security Deposit, Payment and Performance.	25
20.	Import License.	25
21.	Terms of Payment.	25
22.	Price Reduction for Delay in Completion of Contract.	26
23.	Insurance.	27
24.	Payment Due from the Supplier.	27
25.	Sales Tax clearance & GST rating, Audited Accounts	27
26.	Certificate of exemption from Goods & Services Tax.	27
27.	Supplier's Responsibility.	27
28.	Validity.	28
29.	Evaluation.	28
30.	Minimum qualification criteria of Bidders.	30

31.	Jurisdiction of High Court of ODISHA.	30
32.	Correspondences.	34
33.	Official Address of the Parties to the Contract.	34
34.	Outright rejection of Tenders.	35
35.	Documents to be treated as confidential.	36
36.	Scheme/Projects.	36

PART-I
SECTION-II

GENERAL TERMS AND CONDITIONS OF CONTRACT [G.T.C.C.]

1. **Scope of the contract:**

The scope of the contract shall be to design, manufacture, supply of equipment as per the specification at the consignee's site, and rendering services in accordance with the enclosed technical specification and bill of quantity.

2.0 **Definition of terms:**

For the purpose of this specification and General Terms and Conditions of contract [GTCC], the following words shall have the meanings hereby indicated, except where otherwise described or defined.

2.1 "The Purchaser" shall mean the Chief General Manager [Telecom] for and on behalf of ODISHA POWER TRANSMISSION CORPORATION LTD., Bhubaneswar.

2.2 "The Engineer" shall mean the Engineer appointed by the Purchaser for the purpose of this contract.

2.3 "Purchaser's Representative" shall mean any person or persons or consulting firm appointed and remunerated by the Purchaser to supervise, inspect, test and examine workmanship and materials of the equipment to be supplied.

2.4 "The supplier" shall mean the bidder whose bid has been accepted by the purchaser and shall include the bidder's executives, administrators, successors and permitted assignees.

2.5 "Equipment" shall mean and include all machinery, apparatus, materials, and articles to be provided under the contract by the suppliers.

2.6 "Contract Price" shall mean the sum named in or calculated the bid.

2.7 "General Condition" shall mean these General Terms and Conditions of Contract.

2.8 "The Specification" shall mean both the technical as well as commercial parts of the specification annexed to or issued with GTCC and shall include the schedules and drawings, attached thereto as well as all samples and pattern, if any.

2.9 "Month" shall mean "Calendar month".

2.10 "Writing" shall include any manuscript, type written, printed or other statement reproduction in any visible form and whether under seal or under hand.

2.11 "Basic Price (Taxable value for Goods) at the point of destination" shall mean the price quoted by the bidder for equipment and material at the consignee's store/site. The cost is inclusive of packing, forwarding, freight, insurance and all expenses and taxes & duties at the end of the supplier excluding Goods & Service Tax. The Goods & Service Tax shall be

shown in a separate column item wise alongside the Basic Price quoted at the applicable rate in the Tax Invoice. The applicable rate of GST shall refer to the HSN code of the material supplied. The Basic Price and GST thereon shall be the “FOR Destination Price” as quoted by the bidder.

- 2.12 The term “Contract document” shall mean and include GTCC, specifications, schedules, drawings, form of tender, Notice Inviting Tender, covering letter, schedule of prices or the final General Conditions, any special conditions, applicable to the particular contract.
- 2.13 Terms and conditions not herein defined shall have the same meaning as are assigned to them in the Indian Contract Act, failing that in the Odisha General Clauses Act.

3. **Manner of execution:**

All equipment supplied under the contract shall be manufactured in the manner, set out in the specification or where not set out, to the reasonable satisfaction of the Purchaser’s representative.

4. **Inspection and Testing:**

- [i] The purchaser’s representative shall be entitled at all reasonable times during manufacture to inspect, examine and test at the supplier’s premises, the materials and workmanship of all equipment/materials to be supplied under this contract and if part of the said equipment/material is being manufactured in other premises, the supplier shall obtain for the purchaser’s representative permission to inspect, examine and test as if the equipment/material were being manufactured in the contractor’s premises. Such inspection, examination and testing shall not relieve the supplier from his obligations under the contract.
- [ii] The Supplier shall give to the purchaser adequate time/notice (at least clear 15 days for inside the state suppliers and 20 days for outside the state suppliers) in writing for inspection of materials indicating the place at which the equipment/material is ready for testing and inspection and shall also furnish the shop Routine Test Certificate, Calibration certificates of Testing instruments, calibrated in Govt. approved laboratory with authenticity letter of that laboratory along with the offer for inspection. A packing list along with the offer, indicating the quantity which can be delivered in full truck load/Mini truck load to facilitate issue of dispatch instruction shall also be furnished.
- [iii] Where the contract provides for test at the Premises of the supplier or any of his sub-vendors, the supplier shall provide such assistance, labour, materials, electricity, fuel and instruments, as may be required or as may be reasonably demanded by the Purchaser’s representative to carry out such tests efficiently. The supplier is required to produce shop

routine test Certificate, calibration certificates of Testing Instruments before offering their materials/equipment for inspection & testing. The test house/laboratory where tests are to be carried out must be approved by the Govt. A letter pertaining to Govt. approved laboratory must be furnished to the purchaser along with the offer for inspection.

- [iv] After completion of the tests, the Purchaser's representative shall forward the test results to the Purchaser. If the test results conform to the specific standard and specification, the Purchaser shall approve the test results and communicate the same to the supplier in writing. The supplier shall provide at least five copies of the test certificates to the Purchaser.
- [v] The Purchaser has the right to have the tests carried out at his own cost by an independent agency whenever there is dispute regarding the quality of supply.
- [vi] If the firm fails to present the offered items for inspection/testing as per their inspection call due to any reason(s) during the visit of inspecting officer at the testing site, the firm shall have to bear all expenses towards repetition of inspection and testing of the total offered quantity or part thereof.

5. **Training facilities.**

The supplier shall provide all possible facilities for training of Purchaser's Technical personnel, when deputed by the Purchaser for acquiring first-hand knowledge in assembly of the equipment, its erection, commissioning and for its proper operation & maintenance in service, wherein it is thought necessary by the purchaser.

6. **Rejection of Materials.**

In the event any of the equipment /material supplied by the manufacturer is found defective due to faulty design, bad workmanship, bad materials used or otherwise not in conformity with the requirements of the Specification, the Purchaser shall either reject the equipment/material or ask the supplier in writing to rectify or replace the defective equipment/material free of cost to the purchaser. The Supplier on receipt of such notification shall either rectify or replace the defective equipment/material free of cost to the purchaser within 15 days from the date of issue of such notification by the purchaser. If the supplier fails to do so, the Purchaser may:-

- [a] At its option replace or rectify such defective equipment /materials and recover the extra costs so involved from the supplier plus fifteen percent and/or.
- [b] Terminate the contract for balance work/supplies, with enforcement of penalty Clause as per contract for the un-delivered goods and with forfeiture of Performance Guarantee/ Composite Bank guarantee.

- [c] Acquire the defective equipment/materials at reduced price, considered equitable under the circumstances.

7. Experience of Bidders:

The bidders should furnish information regarding experience particularly on the following points:

- [i] Name of the manufacturer:
- [ii] Standing of the firm and experience in manufacture of equipment/material quoted:
- [iii] Description of equipment/material similar to that quoted, supplied and installed during the last two years with the name(s) of the Organizations to whom supplies were made wherein, at least one (1) certificate shall be from a state/central P.S.U.
- [iv] Details as to where **supplied and** installed etc.
- [v] Testing facilities at manufacturer's works.
- [vi] If the manufacturer is having collaboration with another firm [s], details regarding the same.
- [vii] A list of purchase orders of identical material/equipment offered as per technical specification executed during the last two years along with users certificate. User's certificate shall be legible and must indicate, user's name, address, designation, place of use, and satisfactory performance of the equipment/materials for at least two years from the date of commissioning. Wherein at least one (1) certificate shall be from a State/Central or P.S.U. Bids will not be considered if the past manufacturing experience is found to be un-satisfactory or is of less than 2 (two) years on the date of opening of the bid and bids not accompanying user's certificate will be rejected..

8. Language and measures:

All documents pertaining to the contract including specifications, schedule, notices, correspondence, operating and maintenance instructions, drawings or any other writing shall be written in English language. The metric system of measurement shall be used exclusively in this contract.

9. Deviation from specification:

It is in the interest of the tenderers to study the specification, specified in the tender schedule thoroughly before tendering so that, if any deviations are made by the Tenderers,(both commercial and Technical), the same are prominently brought out on a separate sheet under heading "Deviations Commercial" and "Deviations Technical".

A list of deviations shall be enclosed with the tender. Unless deviations in scope, technical and commercial stipulations are specifically mentioned in the list of deviations, it

shall be presumed that the tenderer has accepted all the conditions, stipulated in the tender specification, notwithstanding any exemptions mentioned therein.

10. **Right to reject/accept any tender:**

The purchaser reserves the right either to reject or to accept any or all tenders if the situation so warrants in the interest of the purchaser. Orders may also be split up between different Tenderers on individual merits of the Tenderer. The purchaser has exclusive right to alter the quantities of materials/ equipment at the time of placing final purchase order. After placing of the order, the purchaser may defer the delivery of the materials. It may be clearly understood by the Tenderer that the purchaser need not assign any reason for any of the above action [s].

11. **Supplier to inform himself fully:**

The supplier shall examine the instructions to tenderers, general conditions of contract, specification and the schedules of quantity and delivery to satisfy himself as to all terms and conditions and circumstances affecting the contract price. He shall quote price [s] according to his own views on these matters and understand that no additional allowances except as otherwise provided there in will be admissible. The purchaser shall not be responsible for any misunderstanding or incorrect information, obtained by the supplier other than the information given to the supplier in writing by the purchaser.

12. **Patent rights Etc.**

The supplier shall indemnify the Purchaser against all claims, actions, suits and proceedings for the infringement of any patent design or copy right protected either in the country of origin or in India by the use of any equipment supplied by the manufacturer. Such indemnity shall also cover any use of the equipment, other than for the purpose indicated by or reasonably to be inferred from the specification.

13. **Delivery:-**

- [a] Time being the essence of the contract; the equipment shall be supplied within the delivery period, specified in the contract. The Purchaser, however, reserves the right to reschedule the delivery and change the destination if required. The delivery period shall be reckoned from the date of placing the Letter of Intent/Purchase order, as may be specified in LOI/Purchase order.
- [b] The desired delivery period shall be as indicated at Appendix-II (Quantity & Delivery Schedule) of Section-IV (Technical Specification).

14. **Despatch instructions.**

I] The equipment / materials should be securely packed and dispatched directly to the specified site at the supplier's risk by Road Transport only.

II] **Loading & unloading of Ordered Materials.**

It will be the sole responsibility of the supplier for loading and unloading of materials both at the factory site and at the destination site/store.

The Purchaser shall have no responsibility on this account.

15. **Supplier's Default Liability.**

[i] The Purchaser may, upon written notice of default to the supplier, terminate the contract in circumstances detailed hereunder.

[a] If in the judgement of the Purchaser, the supplier fails to make delivery of equipment/material within the time specified in the contract or within the period for which if extension has been granted by the Purchaser in writing in response to written request of the supplier.

[b] If in the judgement of the Purchaser, the supplier fails to comply with any of the provisions of this contract.

[ii] In the event, Purchaser terminates the contract in whole or in part as provided in Clause-15 (I) of this section, the Purchaser reserves the right to purchase upon such terms and in such a manner as he may deem appropriate in relation to the equipment/material similar to that terminated and the supplier will be liable to the Purchaser for any additional costs for such similar equipment/material and/or for penalty for delay as defined in clause-22 of this section until such reasonable time as may be required for the final supply of equipment.

[iii] In the event the Purchaser does not terminate the contract as provided in clause 15(I) of this Section, supplier shall be liable to the Purchaser for penalty for delay as set out in Clause-22 of this section until the equipment is accepted. This shall be based only on written request of the supplier and written willingness of the Purchaser.

16 **Force Majeure:**

The supplier shall not be liable for any penalty for delay or for failure to perform the contract for reasons of force majeure such as acts of god, acts of the public enemy, acts of Govt., Fires, floods, epidemics, Quarantine restrictions, strikes, Freight Embargo and provided that the supplier shall within Ten (10) days from the beginning of delay on such account notify the purchaser in writing of the cause of delay. The purchaser shall verify the facts and grant such extension, if facts justify.

17. Extension of time:-

If the delivery of equipment/material is delayed due to reasons beyond the control of the supplier, the supplier shall without delay give notice to the purchaser in writing of his claim for an extension of time. The purchaser on receipt of such notice may or may not agree to extend the contract delivery date as may be reasonable but without prejudice to other terms and conditions of the contract.

18. Guarantee period: - (As per clause 35 of the technical specification).

- [i] The stores covered by this specification should be guaranteed for satisfactory operation and against defects in design, materials and workmanship for a period of at least **36** thirty six] months from the last date of delivery (in case of multiple lots, the last date of delivery of each lot shall be considered for this purpose). The above guarantee certificate shall be furnished in triplicate to the purchaser for his approval.

Any defect noticed during this period should be rectified/replaced by the supplier free of cost to the purchaser provided such defects are due to faulty design, bad workmanship or bad materials used, within one month upon written notice from the purchaser failing which provision of **clause 22 (ii) of GTCC i.e. Price Reduction Schedule** shall apply.

- [ii] The supplier's liability shall be to the extent of repair/replacement of such defective equipment/material either arising from faulty design or defective equipment/materials and /or bad workmanship. Such defective equipment /materials shall be handed over to the supplier for repair or replacement by a new one, unless otherwise repairable at site. The supplier shall complete the repair /replacement work within the reasonable time frame [as mentioned in **clause 22(ii) of GTCC i.e. Price Reduction Schedule**] intimated by OPTCL.

If it becomes necessary for the supplier to replace or repair any defective equipment/materials, the provision of this clause shall apply for the same until the expiry of guarantee period.

Limitation of Liabilities :

The final payment by OPTCL in pursuance of the Contract shall mean the release of the Contractor from all his liabilities under the Contract except for liabilities under Guarantee period. Such contractual liabilities and responsibilities of the Contractor shall prevail till expiry of the guarantee period even after the final payment is released.

Notwithstanding anything to the contrary mentioned herein and to the extent permitted by law, the aggregate liability of Contractor to OPTCL, whether in contract, tort or otherwise, will be limited to **100%** of the contract value.

19. e- B.G. towards security deposit, 100% payment and performance guarantee:

[i] For manufacturers situated Inside & outside the state of Odisha.

A Composite e-Bank Guarantee as per the Proforma enclosed at Annexure-VII of the specification for 10% [ten percent] of the Total Landing cost (Taxable Value plus GST thereon) of the purchase order (In case of successful bidder who is a local Micro and small Enterprise(MSEs) (In the state of Odisha) registered with respective DICs, Khadi, Village, Cottage & Handicrafts Industries, OSIC and NSIC 5% (five percent) shall be furnished from any nationalized/scheduled bank having a place of business at Bhubaneswar, to the office of Chief General Manager [Telecom], OPTCL within 15 days from the date of issue of the purchase order. The e-BG shall be executed for a period of 2 months more than the Guarantee Period, for scrutiny and acceptance, failing which the supply order will be liable for cancellation without any further written notices. The e-B.G should be revalidated as and when intimated to you to cover the entire guarantee period.

[ii] No interest is payable on any kind of e-Bank Guarantee.

[iii] In case of non-fulfillment of contractual obligation, as required in the detailed purchase order/Specification, the composite e-Bank guarantee shall be forfeited.

20. Import License

In case imported materials are offered, no assistance will be given for release of Foreign Exchange. The firm should arrange to import materials from their own quota. Equipment of indigenous origin will be preferred.

21. (A) Terms of Payment.

i) 100% taxable value of each consignment with 100% Goods and Services Tax in full as applicable will be paid on receipt of materials in good condition at stores/desired site and verification thereof, subject to furnishing and approval of

a. Contract cum Performance e-Bank Guarantee at the rate of 10% (Ten percent) of Taxable Value plus GST thereon [In case successful bidder is a local Micro and small Enterprise (MSEs), based in Odisha & registered with respective DICs, Khadi, Village, Cottage & Handicrafts Industries, OSIC and NSIC, **5% (five percent) in place of 10%** (ten percent) will be applicable].

b. Guarantee certificate.

c. Test certificate by the Purchaser.

ii) TDS under **Income Tax Act &** GST Laws for intra state transactions shall be deducted, if applicable.

iii) Any imposition of new tax or revision of tax shall be paid/ reimbursed at the time of dispatch, scheduled or actual whichever is lower (i.e. If delivery is within schedule period, tax variation as applicable shall be paid, and if delivery is made beyond schedule date, any additional financial implication due to statutory variation in tax shall be to bidder's account)

(B) The supplier shall furnish contract cum performance Bank Guarantee of appropriate amount to OPTCL as indicated in (i) above, within 30 days from the date of issue of the purchase order.

22 Price Reduction Schedule for Delay in Completion of Supply under Purchase Order/Contract

(i) If the Supplier fails to deliver the materials/equipment **or complete commissioning** within the delivery schedule, specified in the Purchase Order/ Contract including delivery time extension, if any, granted with waiver of Price Reduction Schedule, ~~the Purchaser shall recover from the Supplier,~~ there will be Price Reduction ~~Schedule~~ for a sum of half per cent (0.5 per cent) of the Taxable Value of the un-delivered equipment /materials for each calendar week of delay or part thereof. For this purpose, the date of receipted challan shall be reckoned as the date of delivery. The total amount of Price Reduction Schedule shall not exceed five per cent (5%) of the Taxable Value of the un-delivered equipment/materials. Equipment will be deemed to have been delivered only when all its components, accessories and spares as per technical Specification are also delivered. If certain components, accessories and spares are not delivered in time, the equipment/materials will be considered delayed until such time as the missing components, accessories and spares are delivered.

(ii) During the guarantee period, if the Supplier fails to rectify/replace the equipment/ material/ **installation** within 30 days from the date of intimation of defect by the purchaser, then there will be Price Reduction ~~Schedule~~ at the rate of half percent (0.5%) of the Total Taxable Value for each calendar week of delay or part thereof ~~shall be recovered by the purchaser.~~ For this purpose, Price Reduction Schedule shall be reckoned from the 30th day from the date of issue of letter on defectiveness of equipment/material. The total amount of Price Reduction Schedule in this case shall not exceed 10% (TEN PERCENT) of the Purchase Order/Contract amount except GST (i.e. Total Taxable Value). If the defects, so intimated are not rectified or equipment/materials not replaced by the supplier within the guarantee period, then whole of the C.P.B.G. will be forfeited by the purchaser, without any intimation to the supplier.

23. **Insurance**

The Supplier shall undertake insurance of stores covered by this Specification unless otherwise stated. The responsibility of delivery of the stores at destination in good condition rests with the Supplier. Any claim with the Insurance Company or transport agency arising due to loss or damage in transit has to be settled by the supplier. The Supplier shall undertake free replacement of materials damaged or lost, which will be reported by the consignee within 30 days of receipt of the materials at destination without awaiting for the settlement of their claims with the carriers and underwriters.

24. **Payment Due from the Supplier.** All costs and damages, for which the supplier is liable to the purchaser, will be deducted by the purchaser from any money, due to the supplier, under any of the contract (s), executed with OPTCL.

25. **~~Sales Tax clearance certificate~~, Rating under Goods and Services Tax and Balance sheet and profit & Loss Account:**

The following documents are to be submitted at the time of Tender Submission:

- i. Compliance rating under Goods and Services Tax for immediate preceding financial year.
- ii. Audited Balance Sheet and Profit & Loss Account of the bidder for the previous three years to assess the financial soundness of the bidder(s).
- iii. GST registration certificate and PAN Card Copy.
- iv. Tax holiday/exemption certificate under GST or any other Act.
- v. TDS exemption certificate under the Income Tax Act or any other act.

26. **Certificate of Exemption from Goods and Services Tax.**

Offers with exemption from Goods and Services Tax shall be accompanied with authenticated attested Photostat copy of exemption certificate. Any claim towards Goods and Services Tax shall be paid on actual basis subject to payment of GST by the supplier. In case Outward supply details of the supplier of Goods in GSTR-1 do not match with GSTR -2 of OPTCL on GSTN portal, the same will be adjusted through debit/credit advice issued by OPTCL under intimation to the supplier after allowing cooling period of 3 months after the date of supply.

27. **Supplier's Responsibility.**

Notwithstanding anything mentioned in the Specification or subsequent approval or acceptance by the Purchaser, the ultimate responsibility for design, manufacture, materials used and satisfactory performance shall rest with the Tenderers. The Supplier(s) shall be responsible for any discrepancy noticed in the documents, submitted by them along with the bid(s).

28. Validity.

Prices and conditions contained in the offer should be kept valid for a minimum period of **180** days from the date of opening of the tender, failing which the tender shall be rejected.

29. EVALUATION.

(I) Evaluation of price bids will be on the basis of the FOR DESTINATION PRICE including Goods and Services Tax & other levies as may be applicable. The FORD PRICE shall consist of the following components:

- a) Taxable value of equipment/materials including mandatory spares, if any for maintenance of equipment. (At discretion of the purchaser)
- b) Good and Services Tax
- c) Other levies, if any.
- d) Test charges, if any.
- e) Supervision of erection, testing and commissioning charges, if any.
- f) Any other items, as deemed proper for evaluation by the purchaser.
- g) Loading will be made for items not quoted by the bidder at the highest rate quoted by other bidders unless particular item is included in other items.
- h) Any imposition of new tax or revision of tax shall be considered between due date of submission of bids and the date of price bid opening.

(II) Weightage shall be given to the Following factors in the Evaluation & Comparison of Bids.

In comparing bids and in making awards, the Purchaser will consider other factors such as compliance with Specification, minimum qualification criteria as per clause-30, outright rejection of tenders clause-34 of this tender, relative quality, adaptability of Supplies or services, experience, financial soundness, record of integrity in dealings, performance of materials/equipment earlier supplied, ability to furnish repairs and maintenance services, the time of delivery, capability to perform including available facilities such as adequate shops, plants, equipment and technical organization.

(III) The local MSE (In the state of Odisha) bidders shall be required to furnish their willingness to match their bid price with that of the lowest evaluated bidder without any price preference and in case they agree, they shall be eligible to get up to 30% of the tendered quantity to be distributed suitably among the willing MSE bidders failing which the said 30% of the tendered quantity be awarded to the lowest evaluated bidder.

2) e-Reverse Auction process shall be resorted to in the tender as follows.

STRATEGY FOR E-REVERSE AUCTION	
1	Bidders are required to go through the guide lines given below and submit their acceptance to the same.
2	e-Reverse Auction (RA) will be conducted in e-tender portal of OPTCL on specified date and time, while bidders shall quote from their own offices/places of their choice. Internet connectivity shall be ensured by the respective agencies/bidders themselves.

3	Demonstration/ training (if not trained earlier) of bidder's nominated person(s), shall be done by KEONICS to explain all the rules related to e-Reverse Auction/ Business Rule document to be adopted.
4	The strategy to be used for reverse auction shall be "DYNAMIC TEMPLATE BIDDING"
Procedure for electronic Reverse Auctioning (e-RA):	
5	<p>a. The e-RA shall be conducted on www.tenderwizard.com/OPTCL only.</p> <p>b. Bidder has to submit letter towards agreement to the Process related Terms & Conditions for e-Reverse Auction, as per (Reverse Auction Process Compliance Form at Annexure-IA). In non-receipt of the same, vendors will not be allowed to participate in e-RA.</p> <p>c. e-RA shall be carried out after opening of Price bids and completion of Price bid evaluation, which will be intimated only to the techno-commercially qualified bidders by OPTCL as per procedure given below.</p> <p>d. OPTCL reserves the right to conduct e-RA and it is obligatory on part of bidder(s) invited to participate in e-RA process once they have responded to the techno-commercial bid.</p>
6	<p>Prior intimation/ Notice for RA invitation will be given to techno-commercially qualified bidders regarding the date & time of opening of the e-RA.</p> <p>The start bid price (SBP) for e-Reverse Auction of each bidder under a particular package shall be the L1 evaluated price for the subject package including Taxes & Duties for the total scope for subject Package. Taking the above discovered L1 price as the upper limit e-RA will be conducted to determine the lowest possible price.</p> <p>Reverse Auction will be conducted amongst first 50% of the technically qualified bidders arranged in order of prices from lowest to highest, as L1, L2, L3-----Ln, and L1 price will be discovered. Minimum of 3 bidders shall be eligible for e RA. (e.g. If 4 bidders are financially evaluated then the L1, L2 and L3 bidders shall be eligible for e-RA). Number of bidders eligible for participating in RA would be rounded off to next higher integer value if number of technically qualified bidders is odd (e.g. if 7 bids are technically qualified, then RA will be conducted amongst L1 to L4).</p> <p>However, in case only two bidders are found to be responsive, e-RA would be carried out with both the parties without any elimination. However, OPTCL reserves the right to invite the evaluated L1 bidder for negotiation without conducting the e-RA.</p> <p>In case of price submitted by any bidder is found to be abnormal, OPTCL reserves the right to reject the bid of the bidder(s) .</p> <p>Rank of bidders would be displayed as per the total cost to OPTCL, i.e. including Taxes and Duties payable by OPTCL as per the provisions of the bidding document & after e-RA process is over.</p>
7	<p>Names of bidders/ vendors shall not be disclosed during the e-RA process. Names of bidders/ vendors shall be anonymously masked in the e-RA process.</p> <p>(i) In case of RA, start/ reference price and step value of decrement shall be indicated to the bidders at the start of the auction. Any participating bidder can bid one or multiple step decrement lower than the prevailing lowest bid at that time. The Bidder shall be able to view Bid Start Price, Bid Decrement Value, Prevailing Lowest Bid value, last Bid Placed by him and time left for bidding.</p> <p>(ii) The step value of decrement in a package to be offered by bidder (the minimum amount of reduction in the total bid price including all taxes & duties during auction), shall be kept at 0.15% of L1 bidder's final evaluated price (or) at approved amount as</p>

	<p>decided by OPTCL.</p> <p>(iii) Bidders can only quote any value lower than their previous quoted price. However, at no stage, increase in Price will be permissible.</p> <p>(iv) At any point during Reverse Auction, bidding Price field (Total price) shall remain enabled for the bidders. The total reverse auction period shall be unlimited and the initial auction period (1st slot) will be of thirty (30) minutes with provision of auto extension by (10) ten minutes from the schedule/ extended closing time. If any fresh lower bid is received in last ten minutes of auction period or extended auction period, the reverse auction process shall get extended automatically for another 10(ten) minutes. In case, there is no Bid received during schedule/extended slot, the Auction shall get closed automatically without further extension.</p> <p>(v) However, bidders are advised not to wait till the last minute or last few seconds to enter their bid during the period of e-reverse auction to avoid complication related with internet connectivity, network problem, system crash down, power failure etc.</p>
8	<p>After conclusion of e-Reverse Auction i.e. (Closing Price in Reverse Auction will be taken as offered price by the L1 bidder), decrease in price of individual head of the template shall be considered proportionately on all individual line items of the respective head of the price schedule of the successful L1 bidder .</p> <p>Any bid received at the tender wizard server end subsequent to closure of the e-RA shall be summarily rejected and shall not be considered as a valid bid under whatsoever circumstances. For this purpose, tender wizard server log shall prevail.</p> <p>The bidder shall not involve himself or any of his representatives in price manipulation of any kind directly or indirectly by communicating with other bidders.</p> <p>During Reverse Auction, If no bid is received within the specified time, OPTCL, at its discretion, may decide to close the reverse auction process/ proceed with conventional mode of tendering [Evaluation of Part-II (price bid) submitted by bidders earlier].</p>
9	<p>Consequent upon completion of e-Reverse Auction, OPTCL's decision on award of contract shall be final and binding on the bidders.</p> <p>OPTCL shall be at liberty to call the L1 bidder for further process/ negotiation and also at liberty to cancel the e-reverse auction process/ re-tender at any time, without assigning any reason thereof. OPTCL can decide to reschedule or cancel any reverse auction: the bidders shall be informed accordingly.</p> <p>OPTCL/ Service Provider shall not have any liability to bidders for any interruption or delay in access to the e-Tender site/ Reverse Auction link irrespective of the cause.</p>

30. Minimum Qualification Criteria of Bidders.

All the prospective bidders are requested to note that their bids for tendered equipment can only be considered for evaluation if:

- i) The bidder should have **manufacture or supply** experience of above rated or higher capacity material/ equipment for a minimum period of 3 (three) years as on the date of opening of the tender

- ii) At least 50% of the tendered quantity of above rated or higher capacity equipment should have been supplied within the above-stipulated period. (Note: *within the above stipulated period:-i.e. within 03(three) years from the date of opening of this tender).
- iii) The above rated or higher capacity equipment should have at least 3 (three) years successful performance from the date of commissioning. At least one of the performance certificates shall be submitted from Govt. of India/State Govt.(s) or their undertakings.
- iv) The bidder should have conducted type tests on the tendered equipment in Government approved laboratory within ten years from the date of opening of the tender.

31. Jurisdiction of the High Court of Orissa.

Suits, if any, arising out of this contract shall be filed by either Party in a court of Law to which the jurisdiction of High court of Orissa extends.

Registration certificate of DPIIT:

As per Office Memorandum No.F.No.6/18/2019-PPD, Ministry of Finance, Dept. of Expenditure Public Procurement Division, New Delhi and Office Memorandum No. FIN-CON-MISC-0007/2019/27945/F Dated.16.10.2020 of Finance Department, Govt. of Odisha “*Any bidder from a country which **shares a land border with India** will be eligible to bid in any procurement whether goods, services (Including consultancy services and non-consultancy services) or works (including turnkey projects) **only if the bidder is registered with the Competent Authority, DPIIT** (i.e. Department for Promotion of Industry and Internal Trade)*”. Pursuant to decision of Govt. of India prescribing imposition of restriction on public procurement from bidders of certain countries on ground of defence of India or matters directly or indirectly related thereto, the Office Memorandum No. 4939/F, dated: 13.02.2012 of Finance Department, Govt of Odisha has been amended vide Office Memorandum No 27945 Dtd 16.10.2020 by inserting sub-para-3 (vii) to para-3 thereof. Prescribing the restriction on procurement made by the State Govt., State Public Sector Undertaking including local bodies etc. and directing no procurement shall be made in violation of such restrictions, it is hereby clarified that the provisions of the same shall be applicable for the tenders for works/procurement/Service in OPTCL in both ongoing (Techno-Commercial bid not opened) and future tenders.

The tender documents of OPTCL shall contain following additional clauses and certificate formats.

A. To be incorporated as qualifying requirement of bidder /certificates in case of tenders for Works (including Turn-key works)

I. Any bidder from a country which shares a land border with India will be

eligible to bid in this tender only if the bidder is registered with the Competent Authority as per requirement of Govt. of India.

II. "Bidder" (including the term 'tenderer', 'consultant' or 'service provider' in certain contexts) means any company, including any member of a consortium or joint venture (that is a company),

III. "Bidder from a country which shares a land border with India" for the purpose of this Order means :-

- a. An entity incorporated, established or registered as company in such a country ; or
- b. A subsidiary company of an entity incorporated, established or registered in such a country ' or
- c. An entity substantially controlled through entities incorporated , established or registered in such a country ; or
- d. An entity whose beneficial owner is situated in such a country ; or
- e. An Indian (or other) agent of such an entity ; or
- f. A consortium or joint venture where any member of the consortium or joint venture falls under any of the above.

IV. The beneficial owner for the purpose of (iii)(d) above will be as under :

1. In case of a company the beneficial owner is the natural person(s), who, whether acting along or together, or through one or more juridical person, has a controlling ownership interest or who exercises control through other means.

Explanation-

- a. "Controlling ownership interest" means ownership of or entitlement to more than twenty-five per cent of shares or capital or profits or the company.
 - b. "Control" shall include the right to appoint majority of the directors or to control the management or policy decisions including by virtue of their shareholding or management rights or shareholders agreements or voting agreement;
2. Where no natural person is identified under (1) above, the beneficial owner is the relevant natural person who hold the position of senior managing official ;

V. An Agent is a person employed to do any act for another, or to represent another in dealings with third person.

VI. The successful bidder shall not be allowed to sub-contract works to any contractor from a country which shares a land border with India unless such contractor is registered with the Competent Authority.

Certificate (to be furnished in bidder company's letter head)

I have read the clause regarding restrictions on procurement from a bidder of a country which shares a land border with India and on sub-contracting to contractors from such countries; I certify that this bidder is not from such a country or, if from such a country, has been registered with the Competent Authority and will not sub-contract any work to a contractor from such countries unless such contractor is registered with

the Competent Authority. I hereby certify that this bidder fulfils all requirements in this regard and is eligible to be considered. [Where applicable evidence of valid registration by the Competent Authority shall be attached.

B. To be incorporated as qualifying requirement of bidder /certificates in case of tenders for procurement of goods/services(including consultancy and non-consultancy)

I. Any bidder from a country which shares a land border with India will be eligible to bid in this tender only if the bidder is registered with the Competent Authority as per requirement of Govt. of India

II. "Bidder" (including the term 'tenderer', 'consultant' or 'service provider' in certain contexts) means any person or firm or company, including any member of a consortium or joint venture (that is an association of several persons, or firms or companies), every artificial juridical person not falling in any of the descriptions of bidders stated herein before, including any agency branch or office controlled by such person, participating in a procurement process.

III. "Bidder from a country which shares a land border with India" for the purpose of this Order means :-

- a. An entity incorporated, established or registered in such a country ; or
- b. A subsidiary of an entity incorporated, established or registered in such a country ' or
- c. An entity substantially controlled through entities incorporated , established or registered in such a country ; or
- d. An entity whose beneficial owner is situated in such a country ; or
- e. An Indian (or other) agent of such an entity ; or
- f. A natural person who is a citizen of such a country ; or
- g. A consortium or joint venture where any member of the consortium or joint venture falls under any of the above.

IV. The beneficial owner for the purpose of (iii)(d) above will be as under :

1. In case of a company or Limited Liability Partnership, the beneficial owner is the natural person(s), who, whether acting along or together, or through one or more juridical person, has a controlling ownership interest or who exercises control through other means.

Explanation-

- a. "Controlling ownership interest" means ownership of or entitlement to more than twenty-five per cent of shares or capital or profits or the company.
- b. "Control" shall include the right to appoint majority of the directors or to control the management or policy decisions including by virtue of their shareholding or management rights or shareholders agreements or voting agreement;

2. In case of a partnership firm, the beneficial owner is the natural person(s) who, whether acting along or together, or through one or more juridical person, has ownership or entitlement to more than fifteen per cent of capital or profits of the partnership ;
3. In case of an unincorporated association or body of individuals, the beneficial owner is the natural person(s), who, whether acting along or together, or through one or more juridical person, his ownership of or entitlement to more than fifteen per cent of the property or capital or profits of such association or body of individuals ;
4. Where no natural person is identified under (1) or (2) or (3) above, the beneficial owner is the relevant natural person who hold the position of senior managing official ;
5. In case of a trust, the identification of beneficial owner(s) shall include identification of the author of the trust, the trustee, the beneficiaries with fifteen per cent or more interest in the trust and any other natural person exercising ultimate effective control over the trust through a chain of control or ownership.

V. An Agent is a person employed to do any act for another, or to represent another in dealings with third person.

Certificate (to be furnished in bidder's letter head)

I have read the clause regarding restrictions on procurement from a bidder of a country which shares a land border with India; I certify that this bidder is not from such a country or, if from such a country, has been registered with the Competent Authority. I hereby certify that this bidder fulfils all requirements in this regard and is eligible to be considered. [Where applicable, evident of valid registration by the Competent Authority shall be attached.]

32. Correspondences.

- i) Any notice to the supplier under the terms of the contract shall be served by Registered Post or by hand at the Supplier's Principal Place of Business.
- ii) Any notice to the Purchaser shall be served at the Purchaser's Principal Office in the same manner.

33. Official Address of the Parties to the Contract

The address of the parties to the contract shall be specified:-

[i] **Purchaser:** Chief General Manager (Telecom) OPTCL

Bhubaneswar-751022 (Odisha)

Telephone No. 0674 - 2542403

[ii] **Supplier:** Address
Telephone No.
Fax No.

34. **Outright Rejection of Tenders**

Tenders shall be outrightly rejected if the followings are not complied with.

- [i] The tenderer shall submit the bid in electronic mode only and shall submit the tender cost on or before the date and time of submission of technical bid. In case of local Micro and small Enterprises(MSEs) registered with respective DICs, Khadi, Village, Cottage & Handicrafts Industries, OSIC and NSIC participating in the tender they have to submit notarized hard copy of valid registration as local MSE as above on or before the date and time of submission of technical bid.
- [ii] The tenderer shall submit the bid in electronic mode only
- [iii] The Tender shall not be submitted telegraphically.
- [iv] The prescribed EMD shall be submitted on or before the date and time of submission of technical bid (Part-I).
- [v] The Tender shall be kept valid for a minimum period of 180 days from the date of opening of tender.
- [vi] The Tender shall be submitted in two parts as specified.
- [vii] The Tenders shall be accompanied by a list of major supplies effected prior to the date of opening of tender. Data of at least 3 (three) years shall be furnished.
- [viii] The tenderer shall upload the scanned copy of latest type test certificates (for the tests, carried out on the tendered equipment, being offered). Such type tests should have been conducted within last five years from the date of opening of this tender in a Government approved laboratory/CPRI in presence of any Government Organization's representative(s).
- [ix] The schedule of prices should be filled up fully to indicate the break-up of the prices including taxes and duties. Incomplete submission of this schedule will make the tender liable for rejection. Vide Clause-4(ii) of Part-II.
- [x] The Tenderer should quote 'FIRM' price only and the price should be kept valid for a minimum period of 180 days from the date of opening of the tender.
- [xi] The tenderer shall upload the scanned copy legibly written user's certificate to prove the satisfactory operation of the offered equipment/materials for a minimum period of 3 (three) years from the date of commissioning/use as per the tender specification. User's certificate shall include the detailed address of the user with Equipment/Material, Name and type as per this specification, number of years of satisfactory use/operation & date of issue of this user's certificate with official seal

written in English only & clearly visible must be furnished. At least one of the user's certificates shall be from state or Central Govt. or their Undertakings.

(xii) Guaranteed Technical particulars & Abstract of terms and Conditions should be filled in completely.

(xiii) (a) Detailed information on any litigation or arbitration arising out of contract completed or under execution by it over the last five years. A consistent history of litigation by or against the bidder may result in rejection of bid.

(b)The bidder should not have any pending litigation or arbitration with OPTCL with regard to any project or related activity. The bidder should certify/declare the same in unequivocal terms by way of an affidavit duly sworn before a magistrate. Bid furnished by the bidder shall not be eligible for consideration if it is not accompanied by the affidavit. Further, the bid/ LOA/ LOI shall liable for outright rejection/ cancellation at any stage if any information contrary to the affidavit/ declaration is detected.

35. **Documents to be treated as confidential.**

The supplier shall treat the details of the specification and other tender documents as private and confidential and these shall not be reproduced without written authorization from the Purchaser.

36. **Scheme/Projects**

The materials/equipment covered in this specification shall come under "SLDC DEVELOPMENT FUND "

SECTION – III
[LIST OF ANNEXURES]

The following schedules and proforma are annexed to this specification and contained in Section-III as referred to in the relevant clauses.

1	Declaration form	ANNEXURE-I
2	Abstract of terms and conditions to accompany Section-II of	ANNEXURE-II
3	Schedule of Quantity and Delivery	ANNEXURE-III
4	Abstract of price component	ANNEXURE-IV
5	Schedule of prices	ANNEXURE-V
6	Bank Guarantee form for earnest money deposit	ANNEXURE-VI
7	Composite Bank Guarantee form for security deposit, payment and performance	ANNEXURE-VII
8.	Chart showing particulars of E.M.D.	ANNEXURE – VIII
9.	Data on Experience.	ANNEXURE – IX
10.	Schedule of spare parts.	ANNEXURE-X
11.	Schedule of Installations.	ANNEXURE-XI
12	Schedule of deviations (Technical)	ANNEXURE-XII (A)
13.	Schedule of deviations (Commercial)	ANNEXURE-XII (B)
14	Litigation /Arbitration	ANNEXURE-XIII
15	E-Reverse Auction Compliance Form	ANNEXURE-I (A)
16	DPIIT Certificate	ANNEXURE-XIV
17	Manufacture's Authorization Letter	ANNEXURE-XV

LIST of Documents

The following documents are to be attached in the below name

- 1.PAN
- 2.GSTIN
- 3.Income tax return
- 4.Audited B/s & Profit loss account
5. Certificate of incorporation
6. E payment proof of tender cost

ANNEXURE - I
DECLARATION FORM

To

The Chief General Manager (Telecom)
OPTCL Head Qtrs., Bhubaneswar-751022

Sub:- Tender Specification No-_____

Sir,

1. Having examined the above specification together with terms & conditions referred to therein * I/We the undersigned hereby offer to supply the materials/equipment covered therein complete in all respects as per the specification and General conditions, at the rates, entered in the attached contract schedule of prices in the Tender.
2. * I/We hereby undertake to have the materials/equipment delivered within the time specified in the Tender.
3. * I/We hereby guarantee the technical particulars given in the Tender supported with necessary reports from concerned authorities.
4. * I/We certify to have submitted the bid electronically by remitting *~~cash/money order~~/D.D./ remitting the cost of tender, herewith and this has been acknowledged by your letter/ money receipt No. _____ Dated, _____
5. In the event of Tender, being decided in *my/our favour, * I/We agree to furnish the Composite B.G. in the manner, acceptable to ODISHA POWER TRANSMISSION CORPORATION LTD., and for the sum as applicable to *me/us as per clause-19 of section-II of this specification within 15 days of issue of letter of intent/purchase order failing which *I/We clearly understand that the said letter of Intent/Purchase order will be liable to be withdrawn by the purchaser, and the EMD deposited by us shall be forfeited by OPTCL.

Signed this _____ day of _____ 2025

Yours faithfully

Signature of the Tenderer with seal of the company

[This form should be dully filled up by the tenderer and uploaded at the time of submission of tender.]

* (Strikeout whichever is not applicable).

ANNEXURE-II

ABSTRACT OF GENERAL TERMS AND CONDITIONS OF CONTRACT [COMMERCIAL]

(To be filled up by the tenderer as indicated in the excel sheet)

1	Whether the material/equipment offered conforms to the OPTCL'S specification (If not, specify the deviations in Annexure).	Yes/No
2.a.i	Cost of Tender Document:	Submitted/N ot submitted
2.a.ii	OPTCL Money Receipt No. & Date / D.D No & Date.	
2.b.i	Earnest money furnished.	Submitted/N ot submitted
2.b.ii	Bank Guarantee No. & Date / D.D No. & Date.	
2.c.i	Tender Processing Fee:	Submitted/N ot submitted
2.c.ii	D.D No. & Date.	
3	Manufacturer's supply experience including user's certificate uploaded or not. [As per clause No.7 of Section-II.]	Yes/No
4.a.i	Commercial Deviations to the specification if any	Yes/No
4.a.ii	If Yes, [list uploaded or not, As per clause-9 of the Section-II]	Yes/No
4.b.i	Technical Deviations to the specification if any	Yes/No
4.b.ii	If Yes, list uploaded or not, As per clause-9 of the Section-II	Yes/No
5	Delivery <u>[Period in months from the date of issue of PO]</u>	
6	Guarantee: - Whether agreeable to OPTCL's terms[As per clause-18 of Section-II].	Yes/No
7	Whether agreeable to furnish Composite B.G. in case his tender be successful [As per clause-19 of Section-II]	Yes/No
8	Terms of payment:- Whether agreeable to OPTCL's terms or not [As per clause-21 of Section-II]	Yes/No
9	Nature of price:- FIRM	Yes/No
10	Price Reduction: - Whether agreeable to OPTCL's terms or not (As per clause- 22 of Section-II)	Yes/No
11	Whether STCC/ P&L A/C, Balance Sheet for the required period are uploaded as per clause-25 of Section-II	Yes/No
12	Validity: - Whether agreeable to OPTCL's terms or not[As per clause-28 of Section-II]	Yes/No
13	Whether recent type test certificates from any Government approved laboratory is uploaded or not. [As per clause-30[viii] of section-II]	Yes/No
14	Whether guaranteed technical particulars are uploaded or not	Yes/No
15	Whether dimensional design/drawings uploaded or not	Yes/No
16	Whether materials are ISI/ISO marked.	Yes/No
17	Manufacturer's name and its trademark	
18	Whether registered under GST Laws.	Yes/No

19	Whether declaration form, duly filled in, uploaded or not	Yes/No
----	-----------------------------------------------------------	--------

ANNEXURE-III

SCHEDULE OF QUANTITY AND DELIVERY

(To be filled up by the tenderer)

SL No	Description of materials	Quantity required	Desired Delivery	Destination	Remarks.
1	2	3	4	5	6
(i)	24Fibre(DWSM) OPGW fibre optic Cable	74.555 km	3 months from the date of LOA	Any Store/ site of OPTCL	
(ii)	48Fibre(DWSM) OPGW fibre optic Cable	108.5 km			

Signature of Tenderer
with seal of Company

ANNEXURE-IV

(To be filled up by the tenderer as indicated in the excel sheet)

Sl.No.	Description	To be filled by the bidder.
1	Price basis	F.O.R. Purchaser's destination Stores/site.(Taxable value including packing forwarding, Freight, Insurance, unloading)
2	HSN Code of the Item	
3	GST Identification Number (GSTIN) of the firm	
4	Whether Intra-state supply(i.e. from inside Odisha) or Inter-state supply(i.e from outside Odisha). select from dropdown list	
5	Rate of CGST	
6	Rate of OGST.	
7	Rate of IGST.	
8	Rate of Goods and Services Tax on supervision of erection testing and commissioning	
9	Nature of price.	
10	We hereby undertake and declare that implication of lower Tax and Input Tax Credit benefit as per anti-profiteering (under Section 171 of CGST Act) and other provisions under GST Laws have been fully passed on to the purchaser while quoting the price.	Agreed
11	Any imposition of new tax or revision of tax shall be paid/reimbursed at the time of dispatch, scheduled or actual whichever is lower (i.e. If delivery is within schedule period, tax variation as applicable shall be paid, and if delivery is made beyond schedule date, any additional financial implication due to statutory variation in tax shall be to bidder's account). (Indicated- Yes/No)	

NB:- Abstract of price component shall be done for equipment/material offered, for testing & commissioning charges, if any. All the above prices will be taken during bid price evaluation.

Place:
Date:

Signature of the Bidder
with seal of the company.

ANNEXURE-V

(To be filled up by the tenderer as indicated in the excel sheet)

Item No.	Description	Qty (Unit)	Unit Taxable Value at destination store	Unit GST	Unit landing cost including all taxes and duties.	Total Landing cost including all taxes and duties.
1.	2.	3.	4.	5.	6=(4+5)	7=(6*3)

Signature of Tenderer

With Name, Designation and seal

NB: -

1. The tenderer should fill up the price schedule properly in Excel file in e-tender mode. The tender will be rejected, if the price bid is not submitted in accordance with the price schedule. No post tender correspondence will be entertained on break-up of prices. Also, the supplier should agree for delivery at the desired site.
2. The Tenderer shall give an undertaking in part-I of the bid that, entire implication of lower Tax and Input Tax Credit benefit have been fully passed on to the purchaser as per anti-profiteering and other provisions under GST Laws while quoting the tender price.
3. Conditional offers will not be acceptable.

ANNEXURE-VI

PROFORMA FOR BANK GUARANTEE FORM FOR EARNEST MONEY DEPOSIT

_____ Ref _____ Date _____ Bank Guarantee No: _____

~~1. In accordance with invitation to Bid No. _____ Dated _____ of _____ ODISHA _____ POWER TRANSMISSION CORPORATION LTD. [OPTCL] [herein after referred to as the OPTCL for the purchase _____ of _____ Messers _____ Address _____~~

~~_____ wish/wished to participate in the said tender and as a Bank Guarantee for the sum of Rs. _____ [Rupees _____ Valid for a period of 240 days [Two hundred forty days] is required to be submitted by the Tenderer. We the _____ [Indicate the Name of the Bank] [Hereinafter referred to as 'the Bank'] at the request of M/S _____ [Herein after referred to as supplier (s)] do hereby unequivocally and unconditionally guarantee and undertake to pay during the above said period, on written request by the Chief General Manager [Telecom] ODISHA POWER TRANSMISSION CORPORATION LTD. _____ [Indicate designation of the purchaser] an amount not exceeding Rs. _____ to the OPTCL, without any reservation. The guarantee would remain valid up to _____ [date] and if any further extension to this is required, the same will be extended on receiving instructions from the _____ on whose behalf this guarantee has been issued.~~

~~2. We the _____ [Indicate the Name of the Bank] do hereby, further undertake to pay the amounts due and payable under this guarantee without any demur, merely on a demand from the OPTCL stating that the amount claimed is due by way of loss or damage caused to or would be caused to or suffered by the OPTCL by reason of any breach by the said supplier [s] of any of the terms or conditions or failure to perform the said Bid. Any such demand made on the Bank shall be conclusive as regards the amount due and payable by the Bank under this guarantee. However, our liability under this guarantee shall be restricted _____ to _____ an amount _____ not _____ exceeding Rs. _____ (Rupees in words.....):~~

~~3. We undertake to pay the OPTCL any money so demanded not withstanding any dispute or disputes so raised by the contractor [s] in any suit or proceeding instituted/pending before any Court or Tribunal relating thereto, our liability under this present being absolute and unequivocal. The payment so made by us under this bond shall be a valid discharge of our liability for payment there under and the supplier(s) shall have no claim against us for making such payment.~~

~~4. We, the _____ [Indicate the Name of the Bank] further agree that the guarantee herein contained shall remain in full force and effect during the aforesaid period of 240 days [two hundred forty days] and it shall continue to be so enforceable till all the dues of the OPTCL under or by virtue of the said Bid have been fully paid and its claims satisfied or discharged or till Managing Director, ODISHA POWER TRANSMISSION CORPORATION LTD. certifies that the terms and conditions of the said Bid have been fully and properly carried out by the said Supplier [s] and accordingly discharges this guarantee. Unless a~~

~~demand or claim under this guarantee is made on us in writing on or before the _____ we shall be discharged from all liability under this guarantee thereafter.~~

~~5. We, the _____ [Indicate the name of the Bank] further agree with the OPTCL that the OPTCL shall have the fullest liberty without our consent and without affecting in any manner our obligations hereunder to vary any of the terms and conditions of the said Bid or to extend time of performance by the said Supplier [s] from time to time or to postpone for any time or from time to time any of the powers exercisable by the OPTCL against the said supplier [s] and to forbear or enforce any of the terms and conditions relating to the said bid and we shall not be relieved from our liability by reason of any such variation, postponement or extension being granted to the said Supplier [s] or for any forbearance act or omission on the part of the OPTCL or any indulgence by the OPTCL to the said Supplier[s] or by any such matter or thing whatsoever which under the law relating to sureties would, but for this provision, have effect of so relieving us.~~

~~6. This guarantee will not be discharged due to the change in the name, style and constitution of the Bank or the supplier [s].~~

~~7. We, _____ [Indicate the name of the Bank] lastly undertake not to revoke this Guarantee during its currency except with the previous consent of the OPTCL in writing.~~

~~8. We the _____ Bank further agree that this guarantee shall also be invocable at our place of business at _____ Branch of Bhubaneswar (indicate the name of the branch) in the state of ODISHA.~~

~~Notwithstanding anything contained herein:-~~

~~1) Our liability under this bank guarantee shall not exceed Rs. _____ (Rupees _____).~~

~~2) The bank guarantee shall be valid up to dt. _____~~

~~3) We are liable to pay the guaranteed amount or any part there of under this bank guarantee only & only if you serve upon us at _____ branch at Bhubaneswar (indicate the name of the branch) a written claim or demand on or before dt. _____.~~

~~Dated _____ Day of _____~~

~~_____ For _____~~

~~_____ [Indicate the name of Bank]~~

~~Witness _____ ((Signature, names & address)~~

~~1.~~

~~2.~~

~~**N.B. : To be Stamped in accordance with Stamp Act and the Non-Judicial Stamp Paper of appropriate value should be in the name of Issuing Bank**~~

ANNEXURE-VII

PROFORMA FOR COMPOSITE BANK GUARANTEE FOR SECURITY DEPOSIT PAYMENT AND PERFORMANCE

This Guarantee Bond is executed this _____ day of _____ 20--
by us the _____ Bank at
_____ P.O. _____ P.S. _____
_____ District _____ State _____

1. WHEREAS the ODISHA POWER TRANSMISSION CORPORATION LTD., a body corporate constituted under the Electricity Act, 2003 [hereinafter called "the OPTCL" which shall include its successors and assigns has placed orders No. _____ Date _____] [hereinafter called "The Agreement"] on M/s. _____ [hereinafter called "The Supplier"] which shall include its successors & assigns for supply of materials.

AND WHERE AS the supplier has agreed to supply materials to the OPTCL in terms of the said agreement AND

WHEREAS the OPTCL has agreed [1] to exempt the supplier from making payment of Security [2] to release 100% payment of the cost of materials as per the said agreement and [3] to exempt from performance guarantee on furnishing by the Supplier to the OPTCL, a Composite bank Guarantee of the value of 10 % [ten percent] of the contract price of the said agreement.

NOW THEREFORE, in consideration of the OPTCL having agreed [1] to exempt the Supplier from making payment of Security [2] releasing 100% payment to the Supplier and [3] to exempt from furnishing performance guarantee in terms of the said agreement as aforesaid, we, the _____ [Bank][hereinafter referred to as 'the Bank'] do hereby undertake to pay to the OPTCL an amount not exceeding Rs. _____ [Rupees _____] against any loss or damage caused to or suffered by or would be caused to or suffered by the OPTCL by reason of any breach by the said Supplier [s] of any of the terms or conditions contained, in the said agreement.

2. We the (_____ Bank) do hereby undertake to pay the amounts due and payable under this guarantee without any demur, merely on demand from the OPTCL stating that the amount claimed is due by way of loss or damage caused to or suffered by the OPTCL by reason of any breach by the said Supplier [s] of any of the terms or conditions, contained in the said agreement or by reason of the supplier's failure to perform the said agreement. Any such demand made on the bank shall be conclusive as regards the amount due and payable by the Bank under this guarantee. However, our

liability under this guarantee shall be restricted to an amount not exceeding Rs. _____ [Rupees _____ in words].

3. We the _____ Bank also undertake to pay to the OPTCL any money so demanded notwithstanding any dispute or disputes raised by the supplier [s] in any suit or proceeding instituted/pending before any Court or Tribunal relating thereto our liability under this present being absolute and unequivocal.

The payment so made by us under this bond shall be a valid discharge of our liability for payment there under and the Supplier [s] shall have no claim against us for making such payment.

- 4 We, (_____ Bank) further agree that the guarantee herein contained shall remain in full force and effect during the period that would be taken for the performance of the said agreement and that it shall continue to do so enforceable till all the dues of the OPTCL under or by virtue of the said agreement have been fully paid and its claims satisfied or discharged or till Managing Director, ODISHA POWER TRANSMISSION CORPORATION LTD. certifies that the terms and conditions of the said agreement have been fully and properly carried out by the said Supplier [s] and accordingly discharges this Guarantee.

Unless a demand or claim under this guarantee is made on us in writing on or before the [Date _____], we shall be discharged from all liability under this guarantee thereafter.

5. We, (_____ Bank) further agree that the OPTCL shall have the fullest liberty without our consent and without affecting in any manner our obligations hereunder to vary any of the terms and conditions of the said agreement or to extend time of performance by the said Supplier [s] and we shall not be relieved from our liability by reason of any such variations or extension being granted to the said supplier [s] or for any forbearance, act or omission on the part of the OPTCL or any indulgence by the OPTCL to the said Supplier [s] or by any such matter or thing whatsoever which under the law relating to sureties would but these provisions have effect of so relieving us.

6. This guarantee will not be discharged due to the change in the name, style and constitution of the Bank and supplier [s].

7. We, [_____ Bank] lastly undertake not to revoke this guarantee during its currency except with the previous consent of the OPTCL in writing.

8. We the _____ Bank further agree that this guarantee shall also be invocable at our place of business at ----- Branch of Bhubaneswar (indicate the name of the branch) in the state of ODISHA.

Notwithstanding anything contained herein.

- 1) Our liability under this bank guarantee shall not exceed Rs. ----- (Rupees -----).

- 2) The bank guarantee shall be valid up to dt.-----
- 3) We are liable to pay the guaranteed amount or any part there of under this bank guarantee only & only if you serve upon us at -----branch at Bhubaneswar a written claim or demand on or before dt.-----.

Dated _____ Day of _____

For _____

[Indicate the name of Bank]

Witness ((Signature, names & address)

1.

2.

N.B. : To be Stamped in accordance with Stamp Act and the Non-Judicial Stamp Paper of appropriate value should be in the name of Issuing Bank

ANNEXURE-VIII

CHART SHOWING PARTICULARS OF EARNEST MONEY DEPOSIT
FURNISHABLE BY TENDERERS

1.	Central and State Government Undertakings	Exempted
2.	All other inside & outside state units.	The amount of EMD as specified in the specification /Tender Notice in shape of e-bank guarantee /DD.

NB: - REFUND OF E.M.D.

- [a] In case of unsuccessful tenderers, the EMD will be refunded immediately after the tender is decided. In case of successful tenderer, this will be refunded only after furnishing of Composite Bank Guarantee referred to in clause No.19 of Section-II of this specification.

Suits, if any, arising out of EMD shall be filed in a court of law to which the jurisdiction of High Court of ODISHA extends.

- [b] Earnest Money will be forfeited if the tenderer fails to accept the letter of intent/purchase order, issued in his favour or revises the bid price[s] within the validity period of Bid.

ANNEXURE-IX

DATA ON EXPERIENCE

- [a] Name of the manufacturer.
- [b] Standing of the firm as manufacturer of equipment quoted.
- [c] Description of material/ equipment similar to that quoted [supplied and installed during the last two years with the name of the organizations to whom supply was made].
- [d] Details as to where installed etc.
- [e] Testing facilities at manufacturer's works.
- [f] If the manufacturer is having collaboration with another firm, details regarding the same and present status.
- [g] A list of purchase orders, executed during last three years.
- [h] A list of similar equipment of specified MVA rating, voltage class, Impulse level, short circuit rating, Designed, manufactured, tested and commissioned which are in successful operation for at least two years from the date of commissioning with legible user's certificate. User's full complete postal address/fax/phone must be indicated. (Refer clause No.7 of the Part-I, Section-II of the specification).

Place:

Date:

Signature of tenderer

Name, Designation, Seal

ANNEXURE X

SCHEDULE OF SPARE PARTS FOR FIVE YEARS OF NORMAL OPERATION & MAINTENANCE

SL. No.	Particulars	Quantity	Unit delivery rate	Total price

Place:

Date:—

Signature of Tenderer

Name, Designation, Seal

ANNEXURE-XI
SCHEDULE OF INSTALLATIONS

Description	Specification	Place of installation and complete postal address	Year of commissioning

Place:—

Date

Signature of Tenderer:

Name, Designation, Seal

ANNEXURE-XII
DEVIATION SCHEDULE

Tenderer shall enter below particulars of his alternative proposal for deviation from the specification, if any.

A) Technical

(To be filled up by the tenderer as indicated in the excel sheet)

Sl. No.	Clause No. of Specification	Particulars of Deviations

Place: -

Date

Signature of Tenderer:

Name, Designation, Seal

B) Commercial deviations.

(To be filled up by the tenderer as indicated in the excel sheet)

Sl. No.	Clause No. of Specification	Particulars of Deviations

Place: -

Date

Signature of Tenderer:

Name, Designation, Seal

ANNEXURE – XIII

LITIGATION HISTORY

Year.	Award for or against bidder	Name of client, cause of litigation and matter in dispute	Disputed amount (current value in Rs.)

Place: -

Date

Signature of Tenderer:

Name, Designation, Seal

(Reverse Auction Process Compliance Form)

Annexure-I (A)

(To be submitted on letter head of the bidding company with sign and stamp and along with Technical bid)

To,
CGM (Telecom), OPTCL
Bhubaneswar-751022, Odisha

Sub: Agreement to the Process related Terms & Conditions for e-Reverse Auction.

Dear Sir,

This letter is to confirm that:

- The undersigned is authorized representative of the company.
- We have studied the Commercial Terms and the Business rules governing the Reverse Auction as mentioned in your tender and confirm our agreement to that.
- We also confirm that we have gone through the auction manual and have understood the functionality of the same thoroughly.
- We, hereby, confirm that we will honour the Bids placed by us during the tendering/ e- Reverse auction process as called as e-RA.
- We also confirm that we will accept our Rank / Position that will be displayed when the Bidding Time for the Online Reverse Auction is over.

With regards,

Signature with Designation with company seal Name & Address
Person having power of attorney for the subject package.

ANNEXURE-XIV

Certificate (to be furnished in bidder company's letter head)

I have read the clause regarding restrictions on procurement from a bidder of a country which shares a land border with India and on sub-contracting to contractors from such countries; I certify that this bidder is not from such a country or, if from such a country, has been registered with the Competent Authority and will not sub-contract any work to a contractor from such countries unless such contractor is registered with the Competent Authority. I hereby certify that this bidder fulfils all requirements in this regard and is eligible to be considered. [Where applicable evidence of valid registration by the Competent Authority shall be attached.]

Authorized signatory

Company seal

MANUFACTURE’S AUTHORIZATION LETTER

TENDER NOTICE NO. :

Date:

To

WHEREAS who are official producers of OPGW Cable and having production facilities at do hereby authorize M/s..... located at.....(hereinafter, the “Bidder”) to submit a proposal of the following Products produced by us, for the Supply Requirements associated with the above Tender .

When resold by, these products are subject to our applicable standard end user warranty terms.

We assure you that in the event of, not being able to fulfill its obligation as our Service Provider in respect of our standard Warranty Terms we would continue to meet our Warranty Terms through alternate arrangements and also provide spares in accordance with the Tender for the period of 03 (five) years.

Name

In the capacity of

Signed

Duly authorized to sign the authorization for and on behalf of:

Dated on

SECTION –IV

**Technical Specification
for
Design, manufacture & supply of OPGW cable**

CONTENTS

IMPORTANT INSTRUCTION

GENERAL INFORMATION AND SCOPE

SECTION 1

SECTION 2

OPGW cable and associated hardware & fittings

2.1 Fibre Optic Cable

2.1.1 Required Optical Fibre Characteristics

2.1.1.1 Physical Characteristics

2.1.1.2 Attenuation

2.1.2 Fibre Optic Cable Construction

2.1.2.1 Optical Fibre Identification

2.1.2.2 Buffer Tube

2.1.2.3 Optical Fibre Strain & Sag-tension chart

2.1.2.4 Cable Materials

2.1.2.4.1 Filling Materials

2.1.2.4.2 Metallic Members

2.1.2.4.3 Marking, Packaging and Shipping

2.1.2.5 Optical Ground Wire (OPGW)

2.1.2.5.1 Central Fibre Optic Unit

2.1.2.5.2 Basic Construction

2.1.2.5.3 Breaking Strength

2.1.2.5.4 Electrical and Mechanical Requirements

2.1.2.5.5 Operating conditions

3.0 Inspection & Testing requirement

3.1 Testing Requirements

3.1.1 Type testing

3.1.2 Type Test Samples

3.1.3 List of Type tests

3.1.3.1 Type Tests for Optical Fibres

- 3.1.3.2 Type Tests for OPGW Cables
- 3.2 Factory Acceptance Tests
 - 3.2.1 Sampling for FAT
 - 3.2.2 Production Testing
 - 3.2.3 Factory Acceptance Tests on Optical Fibre
 - 3.2.4 Factory Acceptance Tests on OPGW Cable
- 4.0 Guaranteed Technical Particulars of OPGW Cable & Hardware accessories

IMPORTANT INSTRUCTION

(Please read the following instructions carefully before submitting your bid)

1. All the drawings, i.e. dimension, elevation, side view, front view, plan, cross sectional view, isometric view, important component drawing etc., in PDF along with AutoCAD format and manuals (Technical/Installation/Operation) in PDF format, for offered item shall be submitted. The hard copies as per specification also shall be submitted. All above documents should be legible.
2. The acceptability of type test report submitted by any bidder/EPC agency shall be strictly in adherence to the broad guidelines mentioned in clause no 2 of "GUIDELINES FOR THE VALIDITY PERIOD OF TYPE TEST(S) CONDUCTED ON MAJOR ELECTRICAL EQUIPMENT IN POWER TRANSMISSION" published in May 2020.
3. The Bidder/ EPC agency shall have to submit all the required type test reports for the offered item along with the accessories. In case of submission of soft copy of type test report, high resolution colour scan of the original test report must be submitted. Scanned copy of Xerox of type test reports shall not be entertained. If required, the firm has to show the original type test report for the purpose of verification. In absence of this, the evaluation shall be carried out accordingly as non-submission of type test reports. The type test report of Circuit Breaker submitted by the manufacturer shall be considered valid if the date of type test does not exceed 10 years as on the last date of submission of bid; provided:
 - a. There is no major changes introduced in the basic design / technology /material /mechanical /construction /functionalities /performance characteristics/ manufacturing process of the equipment.
- OR
- b. Until the relevant IS/IEC / statutory guidelines is revised which warrants fresh type tests because of introduction of new type tests even though there is no change in material/basic design of the equipment.
4. The Bidder/ EPC agency must fill up all the point of GTP for offered item/s. Instead of indicating "refer drawing, or as per IS/IEC", the exact value/s must be filled in. All the points other than GTP, which are asked to confirm in technical specifications must be submitted separately with the bid.
5. The Bidder/ EPC agency is required to impart training in view of manufacture, assembly, erection, operation and maintenance for offered item, at his works, to the person/s identified by OPTCL, in the event of an order, free of cost. The cost of logistics will be borne as per the clauses of respective purchase orders/work orders.
6. The discrepancies between the specification and the catalogues or literature, submitted as part of the offer or with prevalent standards or government guidelines shall not be considered as valid deviations unless otherwise the same deviations related to TS is brought out separately by the Bidder/ EPC agency in the pre-bid queries or in form of clarification.
7. If any modifications felt necessary to improve performance, efficiency and utility of equipment, the same must be submitted along with pre bid queries which reasons duly supported by documentary evidences and such modifications not mentioned in pre bid queries will not be considered.
8. For purpose of Agreement, the firm shall provide warranty as specified in the purchase order / tender document. Notwithstanding the foregoing, Supplier agrees to waive the expiration of the Warranty Period in the event where in a pattern of defect/trend of failure is observed after the Warranty Period in a significant portion of the supplied quantity, or any critical defect discovered which, in Purchaser's opinion, constitutes a threat of damage to property or to the health and safety of any person.
9. Warranty certificate for purchase of any material, whether directly procured by OPTCL or through EPC agency, shall be issued directly in favour of OPTCL.

General Information and Scope

1.2 General Information and Scope

1.2.1.1 The broad scope of this tender includes design, engineering, manufacturing, supply, transportation, insurance, delivery at site, the following as applicable:

i)	24F/ 48F (DWSM) OPGW cable securely packed with the cable drum as per the detail specification. Preferable drum schedule; 24F OPGW: (a) 41.535 Km of OPGW as per the drum schedule attached in Annexure-XIX (b) 33.02 Km of OPGW as per the drum schedule attached in Annexure-XVIII 48F OPGW: (a) 3.50 Km of 48F OPGW as per the drum schedule attached in Annexure-XVII
ii)	The drum Schedule for the rest 105 km of 48F OPGW shall be provided to the successful firm after the award of the contract.

1.2.2: Mostly, the OPGW Cable under this specification shall be installed against replacement of existing earth-wire, under dead line/ live line conditions. All the transmission lines where OPGW shall be commissioned are combination of 400kV, 220kV and 132 kV voltage class.

Training (OPGW)

The supplier shall provide all possible facilities for training of Purchaser's Technical personnel, when deputed by the Purchaser for acquiring first-hand knowledge in the production process, jointing, splicing, etc at the works of the manufacturer, wherein it is thought necessary by the purchaser.

2. OPGW cable

This section describes the functional & technical specifications of OPGW cable and associated hardware & fittings.

2.1. Fibre Optic Cable

This section defines the requirements for G.652D Dual-window Single mode (DWSM) telecommunications grade fibre optic cable. Bidders shall furnish with their bids, detailed descriptions of the fibres & cable(s) proposed.

All optical fibre cable including fibre itself and all associated installation hardware shall have a minimum guaranteed design life span of 25 years. Documentary evidence in support of guaranteed life span of cable & fibre shall be submitted by the Contractor during detailed engineering.

2.1.1. Required Optical Fibre Characteristics

This section describes the characteristics of optical fibre to be provided under this specification.

2.1.1.1. Physical Characteristics

Dual-Window Single mode (DWSM), G.652D optical fibres shall be provided in the fibre optic cables. DWSM optical fibres shall meet the requirements defined in Table 1-1(a).

2.1.1.2. Attenuation

The attenuation coefficient for wavelengths between 1525 nm and 1575 nm shall not exceed the attenuation coefficient at 1550 nm by more than 0.05 dB/km. The attenuation coefficient between 1285 nm and 1330 nm shall not exceed the attenuation coefficient at 1310 nm by more than 0.05 dB/km. The attenuation of the fibre shall be distributed uniformly throughout its length such that there are no point discontinuities in excess of 0.10 dB. The fibre attenuation

characteristics specified in table 1-1 (a) shall be “guaranteed” fibre attenuation of any & every fibre reel.

The overall optical fibre path attenuation shall not be more than calculated below:

Maximum attenuation @ 1550nm: 0.21 dB/km x total km + 0.05 dB/splice x no. of splices + 0.5 dB/connector x no. of connectors

Maximum attenuation @ 1310nm: 0.35dB/km x total km + 0.05 dB/splice x no. of splices + 0.5 dB/connector x no. of connectors

**Table 1-1(a)
DWSM Optical Fibre Characteristics**

Fibre Description:	Dual-Window Single-Mode
Mode Field Diameter:	8.6 to 9.5 μm ($\pm 0.6\mu\text{m}$)
Cladding Diameter:	125.0 $\mu\text{m} \pm 1 \mu\text{m}$
Mode field concentricity error	$\leq 0.6\mu\text{m}$
Cladding non-circularity	$\leq 1\%$
Cable Cut-off Wavelength λ_{cc}	$\leq 1260 \text{ nm}$
1550 nm loss performance	As per G.652 D
Proof Test Level	$\geq 0.69 \text{ Gpa}$
Attenuation Coefficient:	@ 1310 nm $\leq 0.35 \text{ dB/km}$ @ 1550 nm $\leq 0.21 \text{ dB/km}$
Chromatic Dispersion; Maximum: Zero Dispersion Wavelength: Zero Dispersion Slope:	18 ps/(nm x km) @ 1550 nm 3.5 ps/(nm x km) 1288-1339nm 5.3 ps/(nm x km) 1271-1360nm 1300 to 1324nm 0.092 ps/(nm ² xkm) maximum
Polarization mode dispersion coefficient	$\leq 0.2 \text{ ps/km}^{1/2}$
Temperature Dependence:	Induced attenuation $\leq 0.05 \text{ dB}$ (-60°C - +85°C)
Bend Performance:	@ 1310 nm (75 \pm 2 mm dia Mandrel), 100 turns; Attenuation Rise $\leq 0.05 \text{ dB}$ @ 1550 nm (30 \pm 1 mm radius Mandrel), 100 turns; Attenuation Rise $\leq 0.05 \text{ dB}$ @ 1550 nm (32 \pm 0.5 mm dia Mandrel, 1 turn; Attenuation Rise $\leq 0.50 \text{ dB}$

2.1.2. Fibre Optic Cable Construction

Overhead Fibre Optic Cables shall be OPGW (Optical Ground Wire). The OPGW cable is proposed to be installed on the transmission lines of Orissa Power Transmission Corporation Ltd. (OPTCL). The design of cable shall account for the varying operating and environmental conditions that the cable shall experience while in service. The OPGW cable to be supplied shall be designed to meet the overall requirements of all the transmission lines. Normally the tower span of the lines shall not exceed 600 m, however, some of the spans may be up to around 1000 m or more. **(Tower structure given at Annexure-A)**

2.1.2.1. Optical Fibre Identification

Individual optical fibres within a fibre unit and fibre units shall be identifiable in accordance with EIA/TIA 598 or IEC 60304 or Bellcore GR-20 colour-coding scheme. Colouring utilized for colour coding optical fibres shall be integrated into the fibre coating and shall be homogenous. The colour shall not bleed from one fibre to another and shall not fade during fibre preparation for termination or splicing.

Each cable shall have traceability of each fibre back to the original fibre manufacturer's fibre number and parameters of the fibre. If more than the specified number of fibres are included in

any cable, the spare fibres shall be tested by the cable manufacturer and any defective fibres shall be suitably bundled, tagged and identified at the factory by the vendor.

2.1.2.2. Buffer Tube

Loose tube construction shall be implemented. The individually coated optical fibre(s) shall be surrounded by a buffer for protection from physical damage during fabrication, installation and operation of the cable. The fibre coating and buffer shall be strippable for splicing and termination. Each fibre unit shall be individually identifiable utilizing colour coding. Buffer tubes shall be filled with a water-blocking gel.

2.1.2.3. Optical Fibre Strain & Sag-Tension chart

The fibre optic cable shall be designed and installed such that the optical fibres experience no strain under all loading conditions defined in IS 802. Zero fibre strain condition shall apply even after a 25 year cable creep.

For the purpose of this specification, the following definitions shall apply:

Maximum Working Tension (MWT) is defined as the maximum cable tension at which there is *no fibre strain*.

The *no fibre strain* condition is defined as fibre strain of less than or equal to 0.05%, as determined by direct measurements through IEC/ ETSI (FOTP) specified optical reflectometry techniques.

The Cable strain margin is defined as the maximum cable strain at which there is no fibre strain.

The cable Maximum Allowable Tension (MAT) is defined as the maximum tension experienced by the Cable under the worst case loading condition.

The cable max strain is defined as the maximum strain experienced by the Cable under the worst case loading condition.

The cable Every Day Tension (EDT) is defined as the maximum cable tension on any span under normal conditions.

The Ultimate /Rated Tensile Strength (UTS/ RTS/ breaking strength) is defined as the maximum tensile load applied and held constant for one minute at which the specimen shall not break.

While preparing the Sag-tension charts for the OPGW cable the following conditions shall be met: The Max Allowable Tension (MAT) / max strain shall be less than or equal to the MWT/ Strain margin of the cable.

The sag shall not exceed the earth wire sag in all conditions.

The Max Allowable Tension shall also be less than or equal to 0.4 times the UTS.

The 25 year creep at 25% of UTS (creep test as per IEEE 1138) shall be such that the 25 year creep plus the cable strain at Max Allowable Tension (MAT) is less than or equal to the cable strain margin.

The everyday tension (EDT) shall not exceed 20% of the UTS for the OPGW cable.

The Sag-tension chart of OPGW cable indicating the maximum tension, cable strain and sag shall be calculated and submitted along with the bid under various conditions mentioned below:

53° C , no wind and no ice

32° C, no wind and no ice

0°C, no wind and no ice

32° C, full wind and no ice

32° C, 75% full wind and no ice

0° C, 2/3rd / 36% of full wind (IS 802:1977/1995)

The above cases shall be considered for the spans from 100 m to 600 m or higher span length in the range of 50 m spans. Max. vertical sag, max. tension and max sag at 0° C & no wind shall be considered for in line with the design parameter of transmission line. The typical details are indicated in the Appendices. The full wind load shall be considered as the design wind load for all the specified transmission lines as per relevant IS 802 version and the sag-tension chart shall be submitted considering the transmission lines. In case of any span higher than 600m, suitable

OPGW cable meeting sag-tension requirement of transmission line shall also be provided by the Contractor. The Contractor shall submit the stringing chart for review of OPTCL.

2.1.2.4. Cable Materials

The materials used for optical fibre cable construction, shall meet the following requirements:

2.1.2.4.1. Filling Materials

The interstices of the fibre optic unit and cable shall be filled with a suitable compound to prohibit any moisture ingress or any water longitudinal migration within the fibre optic unit or along the fibre optic cable. The water tightness of the cable shall meet or exceed the test performance criteria as per IEC 60794-1-F-5.

The filling compound used shall be a non-toxic homogenous waterproofing compound that is free of dirt and foreign matter, non-hygroscopic, electrically nonconductive and non-nutritive to fungus. The compound shall also be fully compatible with all cable components it may come in contact with and shall inhibit the generation of hydrogen within the cable.

The waterproofing filling materials shall not affect fibre coating, colour coding, or encapsulant commonly used in splice enclosures, shall be dermatologically safe, non-staining and easily removable with a non-toxic cleaning solvent.

2.1.2.4.2. Metallic Members

When the fibre optic cable design incorporates metallic elements in its construction, all metallic elements shall be electrically continuous.

2.1.2.4.3. Marking, Packaging and Shipping

This section describes the requirements for marking, packaging and shipping the overhead fibre optic cable.

- (a) **Drum Markings:** Each side of every reel of cable shall be permanently marked in white lettering with the vendors' address, the Purchaser's destination address, cable part number and specification as to the type of cable, length, number of fibres, a unique drum number including the name of the transmission line & segment no., factory inspection stamp and date.
- (b) **Cable Drums:** All optical fibre cabling shall be supplied on strong drums provided with lagging of adequate strength, constructed to protect the cabling against all damage and displacement during transit, storage and subsequent handling during installation. Both ends of the cable shall be sealed as to prevent the escape of filling compounds and dust & moisture ingress during shipment and handling. Spare cable caps shall be provided with each drum as required.

The spare cable shall be supplied on sturdy, corrosion resistant, steel drums suitable for long periods of storage and re-transport & handling.

There shall be no factory splices allowed within a continuous length of cable. Only one continuous cable length shall be provided on each drum. The lengths of cable to be supplied on each drum is as specified and as shall be intimated after the award of the contract.

2.1.2.5. Optical Ground Wire (OPGW)

OPGW cable construction shall comply with IEEE-1138, 2009. The cable provided shall meet both the construction and performance requirements such that the ground wire function, the optical fibre integrity and optical transmission characteristics are suitable for the intended purpose. The cable shall consist of optical fibre units as defined in this specification. There shall be no factory splices within the cable structure of a continuous cable length.

The composite fibre optic overhead ground wire shall be made up of multiple buffer tubes embedded in a water tight aluminium/aluminium alloy/stainless steel with aluminium coating protective central fibre optic unit surrounded by concentric-lay stranded metallic wires in single or multiple layers. Each buffer tube shall have maximum 12 no. of fibres. All fibres in single buffer tube or directly in central fibre optic unit is not acceptable. The dual purpose of the composite cable is to provide the electrical and physical characteristics of conventional overhead ground wire while providing the optical transmission properties of optical fibre

2.1.2.5.1. Central Fibre Optic Unit

The central fibre optic unit shall be designed to house and protect multiple buffered optical fibre units from damage due to forces such as crushing, bending, twisting, tensile stress and moisture. The central fibre optic unit and the outer stranded metallic conductors shall serve together as an integral unit to protect the optical fibres from degradation due to vibration and galloping, wind and ice loadings, wide temperature variations, lightning and fault current, as well as environmental effects which may produce hydrogen.

The OPGW design of dissimilar materials such as stainless steel tube with aluminium or aluminium-clad-steel wire strands are not allowed. Central fibre optic unit may be of aluminium or stainless steel tube with aluminium protective coating. In case of aluminium protective coating, the coating must completely cover the tubes leaving no exposed areas of tubing that can make electrical contact either directly or indirectly through moisture, contamination, protrusions, etc with the surrounding stranded wires. The tube may be fabricated as a seamless tube, seam welded, or a tube without a welded seam.

2.1.2.5.2. Basic Construction

The cable construction shall conform to the applicable requirements of this specification, applicable clauses of IEC 61089 related to stranded conductors and Table 2.2(a) OPGW Mechanical and Electrical Characteristics. In addition, the basic construction shall include bare concentric-lay-stranded metallic wires with the outer layer having left hand lay. The wires may be of multiple layers with a combination of various metallic wires within each layer. The direction of lay for each successive layer shall be reversed. The finished wires shall contain no joints or splices unless otherwise agreed to by the OPTCL and shall conform to all applicable clauses of IEC 61089 as they pertain to stranded conductors. The wires shall be so stranded that when the complete OPGW is cut, the individual wires can be readily regrouped and then held in place by one hand.

2.1.2.5.3. Breaking Strength

The rated breaking strength of the completed OPGW shall be taken as no more than 90 percent of the sum of the rated breaking strengths of the individual wires, calculated from their nominal diameter and the specified minimum tensile strength.

The rated breaking strength shall not include the strength of the optical unit. The fibre optic unit shall not be considered a load bearing tension member when determining the total rated breaking strength of the composite conductor.

2.1.2.5.4. Electrical and Mechanical Requirements

Table 2-2(a) provides OPGW Electrical and Mechanical Requirements for the minimum performance characteristics. Additionally, the OPGW mechanical & electrical characteristics shall be similar to that of the earthwire being replaced such that there is no or minimal consequential increase in stresses on towers. For the purposes of determining the appropriate Max Working Tension limit for the OPGW cable IS 802:1995 and IS 875: 1987 shall be applied. However the OPGW installation sag & tension charts shall be based on IS 802 version to which the line is originally designed. For the OPGW cable design selection and preparation of sag tension charts, the limits specified in this section shall also be satisfied. The Bidder shall submit sag-tension charts for the above cases with their bids.

Table 1.2(a)
OPGW Electrical and Mechanical Requirements

(1)	Everyday Tension	≤ 20% of UTS of OPGW
(2)	D.C. Resistance at 20°C:	< 1.0 ohm/Km
(3)	Short Circuit Current	≥ 6.32 kA for 1.0 second

2.1.2.5.5. Operating conditions

Since OPGW shall be located at the top of the transmission line support structure, it will be subjected to Aeolian vibration, Galloping and Lightning strikes. It will also carry ground fault

currents. Therefore, its electrical and mechanical properties shall be same or similar as those required of conventional ground conductors.

3.0 Inspection & Testing Requirement

All materials furnished and all work performed under this Contract shall be inspected and tested. Deliverables shall not be shipped until all required inspections and tests have been completed, and all deficiencies have been corrected to comply with this Specification and approved for shipment by the Employer.

Except where otherwise specified, the Contractor shall provide all manpower and materials for tests, including testing facilities, logistics, power and instrumentation, and replacement of damaged parts. The costs shall be borne by the Contractor and shall be deemed to be included in the contract price.

The entire cost of testing for factory, production tests and other test during manufacture specified herein shall be treated as included in the quoted unit price of materials including the expenses of Inspector/Employer's representative as per clause-41 of ITB.

Acceptance or waiver of tests shall not relieve the Contractor from the responsibility to furnish material in accordance with the specifications.

All tests shall be witnessed by the Employer and/or its authorized representative (hereinafter referred to as the Employer) unless the Employer authorizes testing to proceed without witness. The Employer representative shall sign the test form indicating approval of successful tests.

Should any inspections or tests indicate that specific item does not meet Specification requirements, the appropriate items shall be replaced, upgraded, or added by the Contractor as necessary to correct the noted deficiencies at no cost to the Employer. After correction of a deficiency, all necessary retests shall be performed to verify the effectiveness of the corrective action.

The Employer reserves the right to require the Contractor to perform, at the Employer's expense, any other reasonable test(s) at the Contractor's premises, on site, or elsewhere in addition to the specified Type, Acceptance, Routine, or Manufacturing tests to assure the Employer of specification compliance.

3.1 Testing Requirements

Following are the requirements of testing:

1. Type Testing
2. Factory Acceptance Testing
3. **Site Acceptance Testing**

3.1.1 Type Testing

"Type Tests" shall be defined as those tests which are to be carried out to prove the design, process of manufacture and general conformity of the materials to this Specification. Type Testing shall comply with the following:

- (a) All cable & equipment being supplied shall conform to type tests as per technical specification.
- (b) The test reports submitted shall be of the tests conducted within last seven (7) years for OPGW

cable prior to the date of proposal/offer submitted. In case the test reports are older than seven (7) years for OPGW cable on the date of proposal/offer, the Contractor shall repeat these tests at no extra cost to the Employer.

- (c) The Contractor shall submit, within 30 days of Contract Award, copies of test reports for all of the Type Tests that are specified in the specifications and that have previously (before Contract award) been performed. These reports may be accepted by the Employer only if they apply to materials and equipment that are essentially identical to those due to be delivered under the Contract and only if test procedures and parameter values are identical to those specified in this specifications carried out at accredited labs and witnessed by third party / customer's representatives.

In the event of any discrepancy in the test reports or any type tests not carried out, same shall be carried out by Contractor without any additional cost implication to the Employer.

In case the Type Test is required to be carried out, then following shall be applicable:-

- (d) Type Tests shall be certified or performed by reputed laboratories using material and equipment data sheets and test procedures that have been approved by the Employer. The test procedures shall be formatted as defined in the technical specifications and shall include a complete list of the applicable reference standards and submitted for Employer approval at least four (4) weeks before commencement of test(s). The Contractor shall provide the Employer at least 30 days written notice of the planned commencement of each type test.
- (e) The Contractor shall provide a detailed schedule for performing all specified type tests. These tests shall be performed in the presence of a representative of the Employer.
- (f) The Contractor shall ensure that all type tests can be completed within the time schedule offered in his Technical Proposal.
- (g) In case of failure during any type test, the Supplier is either required to manufacture a fresh sample lot and repeat all type tests successfully or repeat that particular type test(s) at least three times successfully on the samples selected from the already manufactured lot at his own expenses. In case a fresh lot is manufactured for testing then the lot already manufactured shall be rejected.

3.1.2 Type Test Samples

The Contractor shall supply equipment/material for sample selection only after the Quality Assurance Plan has been approved by the Employer. The sample material shall be manufactured strictly in accordance with the approved Quality Assurance Plan. The Contractor shall submit for Employer approval, the type test sample selection procedure. The selection process for conducting the type tests shall ensure that samples are selected at random. For optical fibres/ Fibre Optic cables, at least three reels/ drums of each type of fibre/cable proposed shall be offered for selection. For FO cable installation hardware & fittings at least ten (10) samples shall be offered for selection. For Splice enclosures at least three samples shall be offered for selection.

3.1.3 List of Type Tests

The type testing shall be conducted on the following items

- (a) Optical fibres
- (b) OPGW Cable
- (c) OPGW Cable fittings
- (d) Vibration Damper
- (e) Splice Enclosure (Joint Box)
- (f) Approach Cable

3.1.3.1 Type Tests for Optical Fibres

The type tests listed below in table 3-1 shall be conducted on DWDM fibres to be supplied as part of overhead cables. The tests specific to the cable type are listed in subsequent sections.

Table 3-1
Type Tests For Optical Fibres

S. No.	Test Name	Acceptance Criteria	Test procedure
1	Attenuation	As per Section-01 of TS	IEC 60793-1-40 Or EIA/TIA 455-78A
2	Attenuation Variation with Wavelength	As per Section-01 of TS	IEC 60793-1-40 Or EIA/TIA 455-78A
3	Attenuation at Water Peak	As per Section-01 of TS	IEC 60793-1-40 Or EIA/TIA 455-78A
4	Temp. Cycling (Temp dependence of Attenuation)	As per Section-01 of TS	IEC 60793-1-52 Or EIA/TIA 455-3A, 2 cycles
5	Attenuation With Bending (Bend Performance)	As per Section-01 of TS	IEC 60793-1-47 Or EIA/TIA 455-62A
6	Mode Field dia.	As per Section-01 of TS	IEC 60793-1-45 Or EIA/TIA 455-164A/167A/174
7	Chromatic Dispersion	As per Section-01 of TS	IEC 60793-1-42 Or EIA/TIA 455-168A/169A/175A
8	Cladding Diameter	As per Section-01 of TS	IEC 60793-1-20 Or EIA/TIA 455-176
9	Point Discontinuities of attenuation	As per Section-01 of TS	IEC 60793-1-40 Or EIA/TIA 455-59
10	Core-Clad concentricity error	As per Section-01 of TS	IEC 60793-1-20 Or EIA/TIA 455-176
11	Fibre Tensile Proof Testing	As per Section-01 of TS	IEC 60793-1-30 Or EIA/TIA 455-31B
---END OF TABLE---			

3.1.3.2 Type Tests for OPGW Cables

The type tests to be conducted on the OPGW cable are listed in Table 3-2 Type Tests for OPGW Cables. Unless specified otherwise in the technical specifications or the referenced standards, the optical attenuation of the specimen, measured during or after the test as applicable, shall not increase by more than 0.05 dB/Km.

Table 3-2
Type tests for OPGW Cable

S. No.	Test Name	Test Description	Test Procedure
1	Water Ingress Test	IEEE 1138-2009	IEEE 1138-2009 (IEC 60794-1-2 Method F5 or EIA/TIA 455-82B)

Table 3-2
Type tests for OPGW Cable

S. No.	Test Name	Test Description	Test Procedure	
			: Test duration : 24 hours	
2	Seepage of filling compound	IEEE 1138-2009	IEEE 1138-2009 (EIA/TIA 455-81B)	Preconditioning period:72 hours. Test duration: 24 hours.
3	Short Circuit Test	IEEE 1138-2009	IEEE 1138-2009	Fibre attenuations shall be continuously monitored and recorded through a digital data logging system or equivalent means. A suitable temperature sensor such as thermocouple shall be used to monitor and record the temperature inside the OPGW tube in addition to monitoring & recording the temperatures between the strands and between optical tube and the strand as required by IEEE 1138. Test shall be conducted with the tension clamps proposed to be supplied. The cable and the clamps shall be visually inspected for mechanical damage and photographed after the test.
		Or IEC60794-4-10 / IEC 60794-1-2 (2003) Method H1		Initial temperature during the test shall be greater than or equal to ambient field temperature.

4	Aeolian Vibration Test	IEEE 1138-2009 Or IEC60794-4-10 / IEC 60794 -1-2, Method E19	IEEE 1138-2009	Fibre attenuations shall be continuously monitored and recorded through a digital data logging system or equivalent means. The vibration frequency and amplitude shall be monitored continuously and recorded. All fibres of the test cable splice shall be d together in serial for attenuation monitoring. Test shall be conducted with
---	------------------------	-------------------------------------------------------------------------------	----------------	----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------

Table 3-2
Type tests for OPGW Cable

S. No.	Test Name	Test Description	Test Procedure	
				the tension/suspension clamps proposed to be supplied. The cable and the clamps shall be visually inspected for mechanical damage and photographed after the test.
5	Galloping test	IEEE 1138-2009	IEEE 1138-2009	Test shall be conducted with the tension/suspension clamps proposed to be supplied. The cable and clamps shall be visually inspected for mechanical damage and photographed after the test. All fibres of the test cable sample shall be spliced together in serial for attenuation monitoring.
6	Cable Bend Test	Procedure 2 in IEC 60794-1-2 Method E11		The short-term and long-term bend tests shall be conducted in accordance with Procedure 2 in IEC 60794-1-2 E11 to determine the minimum acceptable radius of bending without any increase in attenuation or any other damage to the fibre optic cable core such as bird caging, deformation, kinking and crimping.
7	Sheave Test	IEEE 1138-2009 OR IEC 60794-1-2 (2003) Method E1B	IEEE 1138-2009	Fibre attenuation shall be continuously monitored and recorded through a digital data logging system or equivalent means. The Sheave dia. shall be based on the pulling angle and the minimum pulley dia employed during installation. All fibres of the test cable sample shall be spliced together in serial for attenuation monitoring.
8	Crush Test	IEEE 1138-2009	IEEE 1138-2009	The crush test shall be carried out on a sample of

Table 3-2
Type tests for OPGW Cable

S. No.	Test Name	Test Description	Test Procedure
			<p>(IEC 60794-1-2, Method E3/ EIA/TIA 455-41B)</p> <p>approximately one (1) metre long in accordance with IEC 60794-1-2 E3. A load equal to 1.3 times the weight of a 400-metre length of fibre optic cable shall be applied for a period of 10 minutes. A permanent or temporarily increase in optical attenuation value greater than 0.1 dB change in sample shall constitute failure. The load shall be further increased in small increments until the measured attenuation of the optical waveguide fibres increases and the failure load recorded along with results.</p>
9	Impact Test	IEEE 1138-2009	<p>IEEE 1138-2009, (IEC 60794-1-2 E4/ EIA/TIA 455-25B)</p> <p>The impact test shall be carried out in accordance with IEC 60794-1-2 E4. Five separate impacts of 0.1-0.3kgm shall be applied. The radius of the intermediate piece shall be the reel drum radius \pm 10%. A permanent or temporary increase in optical attenuation value greater than 0.1 dB/km change in sample shall constitute failure.</p>
10	Creep Test	IEEE 1138-2009	<p>IEEE 1138-2009</p> <p>As per Aluminium Association Method, the best-fit straight line shall be fitted to the recorded creep data and shall be extrapolated to 25 years. The strain margin of the cable at the end of 25 years shall be calculated. The time when the creep shall achieve the strain margin limits shall also be calculated.</p>
11	Fibre Strain Test	IEEE 1138-1994	IEEE 1138-1994

Table 3-2
Type tests for OPGW Cable

S. No.	Test Name	Test Description	Test Procedure
12	Strain Margin Test	IEEE 1138-2009	IEEE 1138-2009
13	Stress strain Test	IEEE 1138-2009	IEEE 1138-2009
14	Cable Cut-off wavelength Test	IEEE 1138-1994	IEEE 1138-1994
15	Temperature Cycling Test	IEEE 1138-2009	IEEE 1138-2009 Or IEC 60794-1-2, Method F1
16	Corrosion (Salt Spray) Test	EIA/TIA 455-16A	
17	Tensile Performance Test	IEC 60794-1-2 E1 / EIA/TIA 455-33B	The test shall be conducted on a sample of sufficient length in accordance with IEC 60794-1-2 E1. The attenuation variation shall not exceed 0.05 dB/Km up to 90% of RTS of fibre optic cable. The load shall be increased at a steady rate up to rated tensile strength and held for one (1) minute. The fibre optic cable sample shall not fail during the period. The applied load shall then be increased until the failing load is reached and the value recorded.
18	Lightning Test	IEC 60794-4-10 / IEC 60794-1-2 (2003)	The OPGW cable construction shall be tested in accordance with IEC 60794-1-2, Method H2 for Class 1.
19	DC Resistance	On a fibre optic cable sample of minimum 1 metre length, two contact clamps shall be fixed with a predetermined bolt torque. The	

Table 3-2
Type tests for OPGW Cable

S. No.	Test Name	Test Description	Test Procedure
	Test (IEC 60228)	resistance shall be measured by a Kelvin double bridge by placing the clamps initially zero metre and subsequently one metre apart. The tests shall be repeated at least five times and the average value recorded after correcting at 20°C.	
-End Of Table-			

3.2 Factory Acceptance Tests

Factory acceptance tests shall be conducted on OPGW Cable.

Material shall not be shipped to the Employer until required factory tests are completed satisfactorily, all variances are resolved, full test documentation has been delivered to the Employer, and the Employer has issued Material Inspection & Clearance Certificate (MICC). Successful completion of the factory tests and the Employer approval to ship, shall in no way constitute final acceptance of the system or any portion thereof. These tests shall be carried out in the presence of the Employer's authorised representatives unless waiver for witnessing by Employer's representatives is intimated to the contractor.

Factory acceptance tests shall not proceed without the prior delivery to and approval of all test documentation by the Employer.

The factory acceptance tests for the supplied items shall be proposed by the Contractor in accordance with technical specifications and Contractor's standard FAT testing program. In general the FAT shall include at least: Physical verification, demonstration of technical characteristics, various operational modes, functional interfaces etc.

For Test equipment FAT shall include supply of proper calibration certificates, demonstration of satisfactory performance, evidence of correct equipment configuration and manufacturer's final inspection certificate/ report.

3.2.1 Sampling for FAT

From each batch of equipment presented by the Contractor for Factory acceptance testing, the Employer shall select random sample(s) to be tested for acceptance. Unless otherwise agreed, all required FAT tests in the approved FAT procedures, shall be performed on all samples. The Sampling rate for the Factory acceptance tests shall be minimum 10% of the batch size (minimum 1) for all items. The physical verification shall be carried out on 100% of the offered quantities as per the approved FAT procedure. In case any of the selected samples fail, the failed sample is rejected and additional 20% samples shall be selected randomly and tested. In case any sample from the additional 20% also fails the entire batch may be rejected.

For the OPGW cable hardware fittings & accessories, the minimum sampling rate, and batch acceptance criteria shall be as defined in IS 2486.

The Sampling rate for the Factory acceptance tests shall be 10% of the batch size (minimum 2) for FO cable drums.

Since FAT testing provides a measure of assurance that the Quality Control objectives are being met during all phases of production, the Employer reserves the right to require the Contractor to investigate and report on the cause of FAT failures and to suspend further testing/ approvals until such a report is made and remedial actions taken, as applicable.

3.2.2 Production Testing

Production testing shall mean those tests which are to be carried out during the process of production by the Contractor to ensure the desired quality of end product to be supplied by him. The production tests to be carried out at each stage of production shall be based on the Contractor's standard quality assurance procedures. The production tests to be carried out shall be listed in the Manufacturing Quality Plan (MQP), alongwith information such as sampling frequency, applicable standards, acceptance criteria etc.

The production tests would normally not be witnessed by the Employer. However, the Employer reserves the right to do so or inspect the production testing records in accordance with Inspection rights specified for this contract.

3.2.3 Factory Acceptance Tests on Optical Fibre to be supplied with OPGW

The factory acceptance tests listed in table below are applicable for the Optical fibres to be supplied. The listed tests follow testing requirements set forth in IEEE standard 1138/IEC 60794. The referenced sections specify the detailed test description. The acceptance norm shall be as specified in the above mentioned IEEE standards unless specified otherwise in the technical specifications.

**Table 3-4
Factory Acceptance Tests for Optical Fibres: Optical Tests**

S. No.	Test Name	Acceptance Criteria	Test procedure
1	Attenuation Coefficient	T S, Table 1-1(a)	EIA/TIA 455- 78A
2	Point Discontinuities of attenuation	TS, Section 1.1.2	EIA/TIA 455-59
3	Attenuation at Water Peak	TS ,Table 2-1(a)	EIA/TIA 455- 78A
4	Chromatic Dispersion		EIA/TIA 455-168A/169A/175A
5	Core – Clad Concentricity Error		EIA/TIA 455-/176
6	Cladding diameter		EIA/TIA 455-176
7	Fibre Tensile Proof Testing		EIA/TIA 455-31B
-End of table-			

The test report for the above tests for the fibers carried out by the Fiber Manufacturer and used in the OPGW cables shall be shown to the inspector during OPGW cable FAT and shall be submitted along with the OPGW cable FAT report.

3.2.4 Factory Acceptance Test on OPGW Cable

The factory acceptance tests for OPGW cable specified below in Table follow the requirements set forth in IEEE standard 1138 / IEC 60794. The FAT shall be carried out on 10% of offered drums in each lot as specified in technical specifications and the optical tests shall be carried out in all fibres of the selected sample drums. The Rated Tensile Strength test shall be carried out on one sample in each lot.

**Table 3-5
Factory Acceptance Tests on OPGW
Applicable standard: IEEE 1138 / IEC 60794**

S. No.	Factory Acceptance Test on Manufactured OPGW
1	Attenuation Co-efficient at 1310 nm and 1550 nm
2	Point discontinuities of attenuation
3	Visual Material verification and dimensional checks as per approved DRS/Drawings
4	Rated Tensile Strength
5	Lay Length Measurements

3.3.1 Minimum Site Acceptance Testing Requirement for OPGW Cable

During delivery of the materials at the desired site, required tests shall be carried out in the presence of the site in-charge to ensure the materials to be in good condition. Minimum requirements for OPGW cable site testing are provided in Table 3-4 below.

Item:	Description:
1.	Physical Inspection of the cable along with the drum for any damage
2.	Optical fibre continuity and fibre attenuation with OTDR at 1550 nm
3.	Fibre Optic Cable length measurement using OTDR

48 Fibre OPGW:

The specification for the 48 fibre DWSM OPGW is as follows.

Sl.	Parameter	Technical requirement
1	No. of fibres (DWSM)	48
2	Buffer type	Loose tube
3	Buffer Tube material	Non-matallic
4	No of Buffer tubes	Minimum four(4)
5	No. of fibres per buffer tube	Maximum Twelve(12)

All other parameters are same/proportionate as that of the specification of 24Fibre OPGW.

4.0 GUARANTEED TECHNICAL PARTICULARS OF OPGW CABLE & HARDWARE ACCESSORIES

Sl.No.	Description.	Technical Particulars	
1.	Make & Model		
2.	No. of Fibres in OPGW	24	48
3.	Mode	DW-SM	DW-SM
4.	Buffer type	Loose	Loose
5.	Buffer tube diameter	2.2mm	2.3 mm (Approx)
6.	Buffer tube material	PBT	PBT
7.	No. of buffer tubes	4	4
8.	No. of fibres per tube	6	12
9.	Identification/numbering of individual tubes	Red, green blue and natural.	Different Color/4 Tube Blue, Orange, Green Brown.
10.	No.of empty tubes (if any)	1	N/A
11.	Filling material	Moisture proof & Hydrogen adherent jelly.	Moisture proof & Hydrogen adherent jelly.


12.	Strength members	1	1
13.	Binding yarn/tape	Tapes	Tapes
14.	(i)10% Aluminium clad steel wire (ii)20.3% IACS	(i) 2.25mm (Dia) & 12 Nos. (ii) 2.6 mm (Dia) & 11 Nos. (iii) Other design meeting to the electrical & mechanical parameters as per detail technical specification.	(i) 2.45mm, 13 Nos
15.	Aluminium alloy wires (Diameter & Number)	2.25mm & 3 Nos.	na
16.	Aluminium tube inner diameter	Design dimensional parameters of OPGW should meet the SAG-Tension criteria as enclosed at Appendix-A	6.2mm
17.	Aluminium tube outside diameter (Approx.)		7.9mmj
18.	Cable diameter		12.6 ± 0.13
19.	Cable cross section area		80mm ²
20.	Maximum Breaking load/ Ultimate Tensile Strength	82.10kN	84.9 KN
21.	Fibre Strain margin	0.6%	25% (Zero fibre strain up to 33.96KN Load)
22.	Weight Kgs/Km	488 kgs/km	477
23.	Crush strength	1000kg with a 10cm ² piste	4Kg/mm
24.	Equivalent Modulus of Elasticity	135.8kN/mm ²	137.1 KN/mm ²
25.	Minimum bending radius	300mm	384mm
26.	Maximum bending radius	Short term 300mm Long term 400mm	Short term 512mm Long term 384mm
27.	Maximum permissible tensile stress	-	0.42 KN/mm ²
28.	Permissible CTS Tensile stress	0.669kN/- mm ²	0.21 KN/mm ²
29.	Coefficient of linear expansion	15.3 X 10 ⁻⁶ per °C	14.0 X 10 ⁻⁶ per °C
30.	Coefficient expansion Cladding Core	6.3 X 10 ⁻⁶ per °C	23.0 X 10 ⁻⁶ per °C 11.5 X 10 ⁻⁶ per °C
31.	Nominal operating temperature range	-10 °C to 70 °C	-10 °C to 70 °C
32.	SC current transient peak temperature	41 KA	200°C
33.	Maximum allowable temperature for lightning strike	200	200°C
34.	Available length of cable per drum:	As per Drum Schedule.	As per site requirement.

	Min Max		
35	Splice loss (Min. & Max. Allowable)	0.1dB (Max) 0.05dB (Average)	0.1dB (Max) 0.05dB (Average)
36	Operating Temperature range-	-10 °C to 70 °C	-10 °C to 70 °C
37	Expected Cable Life	25 years.	25 years.
38.	Fibre production method	-	
39.	Core diameter.	9.2 +/-0.5 µm	8.2 ± 0.4 µm
40	Core non circularity	-	≤0.8 %
41.	Cladding diameter	125+/-0.5 µm	125 ± 0.7 µm
42	Core Clad Concentricity Error	< 1 µm	≤ 0.5 µm
43	Cladding non circularity	< 2%	≤ 1.0%
44	Protective coating type & material Primary Secondary.	Acrylate PBT	Acrylate PBT
45	Protective coating Diameter	-	245±5 µm
46	Coating concentricity	>70%	>70%
47	Colour Coding scheme compliant with EIA 395/IEC3047		
48	Attenuation Coefficient @ 1310nm – @1559nm-	≤ 0.35 dB/km ≤ 0.21 dB/km	≤ 0.35 dB/km ≤ 0.21 dB/km
50	Mode field non Circularity	< 2%	
51	Chromatic Dispersion 1310 nm 1550 nm	2.8 ps/ (nm.km) 18 ps/(nm.km)	2.8 ps/(nm.km) 18 ps/(nm.km)

(Bidders are required to upload the guaranteed technical particulars of their offered OPGW cable & Hardware Accessories in the tender wizard)

132kV tower (Normal span- 300m, Conductor 37/3.15 mm AAA, EW-7/3.15mm GS wire)


	DA (0-2 Deg)	DB (0-15 Deg)	DC (15-30 Deg)	DD (30-60 Deg)
A	28908	27550	27810	28280
B	4193	5890	6150	5990
C	4170	3900	3900	4130
D	4230	3900	3900	4300
E	16315	13860	13860	13860
F	2455	0	0	0
G	7606	7606	7606	7606
H	6100+150	6100+150	6100+150	6100+150
I	3150	2600	2650	2475
J	850	1600	1800	1850
K	3150	2600	2350	2475
L	-	-	-	-
M	3028	2525	2770	2291
N	1024	1750	1900	2217
O	3028	2525	2130	2291
P	3045	2560	2905	2665
Q	1200	1900	2000	2600
R	3045	2560	2100	2665
S	5890	6700	7000	8600

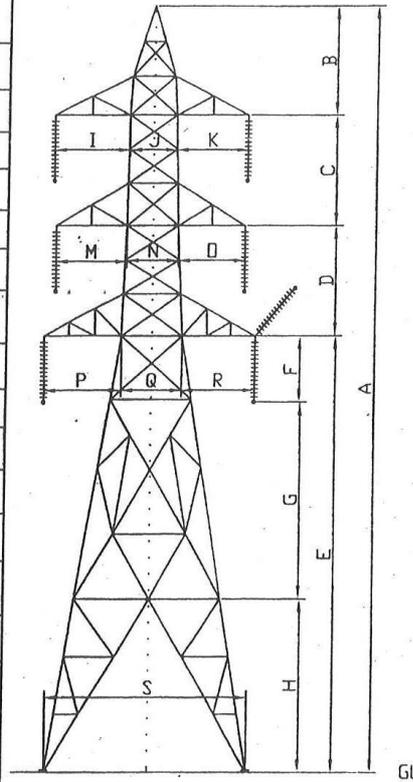

All dimensions are in mm.

220kV(Normal span 350m, Conductor-37/4mm AAA, Earth wire-7/3.15mm GS Wire)

	DA (0-2 Deg)	DB (0-15 Deg)	DC (15-30 Deg)	DD (30-60 Deg)
A	35505	34490	35390	35255
B	5540	7940	7940	8405
C	5175	4900	5350	5050
D	5275	4900	5350	5050
E	19515	16750	16750	16750
F	2768	0	0	0
G	9582	9582	9582	9582
H	7015+150	7015+150	7015+150	7015+150
I	3600	3705	3466	3650
J	1400	1750	2068	2400
K	3600	3025	3166	3650
L	-	-	-	-
M	3591	3612	3757	3450
N	1598	1975	2285	2800
O	3591	3012	2667	3450
P	3900	3475	3950	3250
Q	1800	2200	2500	3200
R	3900	3095	3180	3250
S	7502	7830	8500	9900

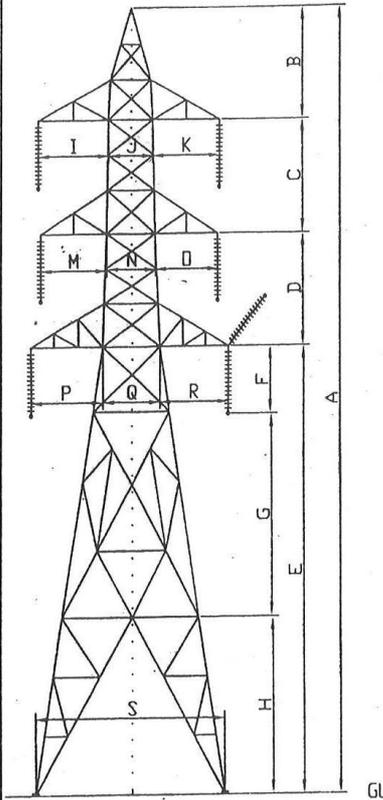

All dimensions are in mm.

Appendix-A**SAG-TENSION CRITERIA OF EXISTING EARTH WIRE IN OPTCL SYSTEM****Design Parameters****Basic Data**

i	Line Voltage	220 Kv	132 kV
ii	Wind Zone	V (50 m/sec)	V (50 m/sec)
iii	Normal Span	350 m	320 m
iv	Wind Pressure	Shall be in accordance with the wind zone 'V'.	Shall be in accordance with the wind zone 'V'.
v	Earth wire type	7/ 3.15	7/ 3.15
vi	Over all Diameter	9.45 mm	9.45 mm
vii	Weight	0.428 kg/m	0.428 kg/m
viii	Rated UTS	5810 kg	5810 kg
ix	Max Working tension @ everyday temperature (32°C) & full wind	3604.25 kg	3448.46 kg
x	Max. sag @ Max. temp.	6.88m	5.850m
xi	Modulus of elasticity	1.94×10 ⁶ kg / cm ²	1.94×10 ⁶ kg / cm ²
xii	Coefficient of linear expansion	0.0000115 / °C	0.0000115 / °C
xiii	Maximum temperature	53 ⁰ C	53 ⁰ C
xiv	Everyday temperature	32 ⁰ C	32 ⁰ C
xv	Minimum temperature	0 ⁰ C	0 ⁰ C

APPENDIX-B**BOQ FOR SUPPLY OF OPGW CABLE & DELIVERY SCHEDULE**

Sl No	Description	UOM	Quantity required	Desired Delivery	Destination
1	24Fibre(DWSM) OPGW fibre optic Cable	Km	74.555	4 Months from the date of LOA	Any store/site of OPTCL
2	48Fibre(DWSM) OPGW fibre optic Cable	KM	108.5	-Do-	-do-

400 KV Meramundali-Mendhasal Line Tower Schedule							
Sl.		Type of	Angle of	Span in	K.M. from	Name of	
No.	Tower no.	Tower	deviation	mtr.	Grid s/s	village	Remarks
1	GTA1	DD					
				50			
2	GTA2	DD					
				50			
	GTC	DD+6					
3	GTB1	DD					
				60			
4	GTB2	DD					
				60			Meramandali Grid Boundary
5	GTC	DD+6					
				100			
6	1//0	DD+9					
				330			
7	1A	DD+18					
				152			Talabahala Road
8	2//0	DD+18					
				370			
9	2A	DD+18					Bhusan Plant
				360			
10	2B	DD+18	32' 45" LT				
				260			Bhusan road & Railway Track
	3//0	DD+18					Barren Land, Paddy field
11				330			Paddy Field
12	3A	DD+6					
				424	754		Paddy Field
13	3A//1	DA					
				391			
14	4//0	DB	12' 22" RT		1.565	Narendrapur	
				355			
15	4//1	DA					Paddy Field

				440			
16	5	DB	6' RT	410		Sibapur	Barren Land,Paddy field
				380			
17	5//1	DA					
				368			
18	5//2	DA					
				432			
19	5//3	DA+6					
				460			
20	5//4	DA					
				350			
21	5//5	DA					
				390			
22	5//6	DA					
				380			Samal Plantation
23	5//7	DA					
				330			
24	5//8	DA					
				385			
25	6	DD	51" RT		5.841	Nimbahali	
				400			Jora
26	6//1	DA					
				410			
27	6//2	DA					
				348			
28	7	DD	45" LT		6.999	Jharbandh	
				287			
29	7//1	DA					
				331			
30	8	DD	55'10" LT				
				350			
31	8//1	DA					
				374			
32	8A	DD	35'40"RT			Meramandali	
				340			
33	8A/1	DA					
				380			
34	8A/2	DA					
				348			
35	8A/3	DA					
				324			

36	8A/4	DA					
				318			
37	9	DC	27'40"RT		9.733	Nimidha	
				385			
38	9//1	DA					
				393			
39	9//2	DA					
				386			
40	9//3	DA					
				415			
41	9//4	DA					
				380			
42	10	DC	24'20"lt		11.692	Baliratnapur	
				288			
43	10//1	DA					
				385			
44	10//2	DA					
				318			
45	11	DB	7'47"LT		12.683	Gopalpur	
				360			
46	11//1	DA					
				360			
47	11//2	DA					
				340			
48	11//3	DA					
				400			
49	11//4	DA					
				420			
50	11//5	DA					
				380			
51	11//6	DA					
				347			
52	12	DC	20'40LT		15.29	Siride	
				280			Paddy Field
53	12//1	DA					
				280			Paddy field, Cultivatation
54	12//2	DA					
				380			Nala cross, sarapa Jora
55	12//3	DA					

				370			132kv khajuriakata dc line,11kv line crossing, paddy field
56	12//4	DA					
				385			Paddy Field,sarapa jora
57	13	DD	36'40"		16.985	Siridi	
				440			cultivatation
58	13//1	DA+6					
				400			cultivatation, Morama Road
59	13//2	DA					
				400			Bado jora, Cultivatatiuon
60	13//3	DA					
				405			Dudhia Zora, Cultivatation
61	14	DD	45'40"		18.63	Hindolo Road	
				220			Nala cross, paddy field
62	14//1	DA					
				350			paddy field
63	14//2	DA					
				324			paddy field
64	14//3	DA					
				371			paddy field
65	15	DD	42'33"RT		19.895	Bahandai	
				300			
66	15//1	DA					
				410			
67	15//2	DA					
				390			
68	15//3	DA+6					
				400			
69	15A	DB	1'35RT		21.395	Matiasahi	
				410			
70	15A//1	DA					
				360			
71	15A//2	DA					
				430			

72	15A//3	DA+6					
				460			
73	15A//4	DA					
				370			
74	15A//5	DA					
				380			
75	16	DB	13'RT		23.805	Bohandei Jungle	
				380			
76	16//1	DA					
				380			
77	16//2	DA					
				440			
78	16A	DC	22'8"RT		25.005	Sorota	
				180			
79	16B	DD	35'43"LT			Sorota	
				330			
80	17	DD	31'0"LT			Sorota	
				300			
81	17//1	DA					
				310			
82	17A	DC	22'RT		26.125	Kadumada	
				310			
83	17A//1	DA					
				340			
84	17A//2	DA					
				330			
85	17A//3	DA					
				306			
86	17A//4	DA+6					
				495			
87	17A//5	DA+6					
				410			
88	18	DC	22'RT		28.316	Chainpur	
				400			
89	18//1	DA					
				380			
90	18//2	DA					
				400			
91	18//3	DA					
				390			
92	18//4	DA					
				390			
93	18//5	DA					

				360			
94	18//6	DA					
				380			
95	18//7	DA					
				380			
96	18//8	DA					
				386			
97	18//9	DA					
				380			
98	19	DC	12'RT		32.162	Chatia	
				420			
99	19//1	DA					
				360			
100	19//2	DA					
				400			
101	19//3	DA					
				430			
102	19//4	DA+6					
				412			
103	19//5	DA					
				408			
104	20	DB	8'27"		34.862	Mangalpur Koregadaia	
				240			
105	21	DC+3	21'45"RT				
				400			
106	21A	DB					
				400			
107	21A//1	DA					
				370			
108	21A//2	DA					
109	21A//3	DA					
				420			
110	21A//4	DA					
				420			
111	21A//5	DA					
				420			
112	21B	DB	0'0		37.652	Mangalpur	
				400			
113	21B//1	DA					
				420			
114	21B//2	DA					
				400			
115	21B//3	DA					
				340			
116	21B//4	DA					

				380			
117	21B//5	DA					
				370			
118	22	DC	15'45"		39.962	Bahapur Road	
				400			
119	22//1	DA+6					
				410			
120	22//2	DA					
				420			
121	22//3	DA					
				390			
122	22//4	DA					
				380			
123	22//5	DA					
				400			
124	23	DB	13'40"LT		42.362	Majhisahi	
				360			
125	23//1	DA+6					
				480			
126	24	DD	34'40"LT		43.202		
				380			
127	24//1	DA					
				300			
128	24//2	DA					
				405			
129	25	DC	20'20"LT		44.287	Saptasayapada	
				420			
130	25//1	DA+6					
				420			
131	26	DB	8'43"		45.127	Mahisapata Road	
				380			
132	26//1	DA					
				400			
133	26//2	DA					
				440			
134	26//3	DA					
				400			
135	26//4	DA					
				350			

136	27	DC	19'20"LT		47.097	Saptasayapada Road
				300		
137	27//1	DA				
				390		
138	27//2	DA				
				380		
139	27//3	DA				
				322		
140	27//4	DA				
				360		
141	28	DC	27'50"		48.849	Searia
				370		
142	28//1	DA				
				360		
143	28//2	DA				
				380		
144	28//3	DA				
				365		
145	28//4	DA				
				368		
146	29	DB	12'LT		50.692	Searia
				346		
147	29//1	DA				
				360		
148	29//2	DA				
				360		
149	29//3	DA				
				360		
150	29//4	DA				
				390		
151	30	DD	38'16"RT		52.508"	Gobindpur
				420		
152	30//1	DA				
				410		
153	30//2	DA				
				401		
154	30//3	DA				
				410		
155	30//4	DA				
				400		
156	31	DD	46'6"RT		54.549	Regada
				380		
157	31//1	DA				

				420			
158	31//2	DA					
				360			
159	31//3	DA					
				360			
160	32	DD	55'20"LT		56.069	Regeda	
				380			
161	32//1	DA					
				326			
162	32//2	DA					
				410			
163	33	DB	8'55"LT		57.465	Gundichapada	
				280			
164	34	DD	30'20"RT				
				250			
165	34//1	DA					
				250			
166	34A	DB	7'40"RT				
				270			
167	35	DC	25'54"LT		58.235	Kuleilo	
						Athagarh Road	

Annexure-XVII**OPGW (48F) DRUM SCHEDULE:**

SL. NO.	LENGTH IN KM.	REMARKS
1	3.5	Transported to 220kV GSS Narendrapur

Annexure-XVIII**OPGW (24F) DRUM SCHEDULE:**

SL. NO.	LENGTH IN KM.	REMARKS
1	3.877	Transported to 400/220/33kV GSS Mendhasala
2	3.602	
3	4.224	
4	2.648	
5	2.537	
	16.888	
6	4.196	Transported to 220/132/33kV GSS Bidanasi
7	2.835	
8	3.966	
9	2.716	
10	2.42	
	16.133	
Total OPGW cable	33.021	

Annexure-XIX

OPGW (24F) DRUM SCHEDULE:

SL. NO.	LENGTH IN KM.	REMARKS
11	3.524	Transported for Ghens-Padampur Line work
12	4.376	
13	4.626	
14	3.382	
15	4.205	
16	3.769	
17	4.577	
18	4.2	
19	4.649	
20	4.227	
TOTAL LENGTH	41.535	

PART – II

PRICE BID

1. PRICE:

- (i) Bidders are required to quote their price(s) for goods offered indicating they are 'FIRM'
- (ii) The prices quoted shall be FOR Destination only at the consignee's site/store inclusive of packing, forwarding, Freight & Insurance. In addition, the break-up of FOR Destination price shall be given as per schedule of Prices in Annexure-V of Section – III. The Bidders has to certify in the price bid that any implication of lower Tax and Input Tax Credit benefit as per anti-profiteering and other provisions under GST Laws, have been fully passed on to the Purchaser, while quoting the tender prices.

2. INSURANCE:

Insurance of materials/equipment, covered by the Specification should normally be done by the Suppliers with their own Insurance Company unless otherwise stated. The responsibility of delivery of the materials/equipment at destination stores/site in good condition rests with the Supplier. Any claim with the Insurance Company or Transport agency arising due to loss or damage in transit has to be settled by the Supplier. The Supplier shall undertake free replacement of equipment/materials damaged or lost which will be reported by the Consignee within 30 days of receipt of the equipment/materials at Destination without awaiting for the settlement of their claims with the carriers and underwriters.

3. CERTIFICATE FOR EXEMPTION FROM GOODS AND SERVICES TAX:

Offers with exemption from Goods and Services Tax shall be accompanied with authenticated proof of such exemption. Authenticated proof for this clause shall mean Photostat copy of exemption certificates, attested by Gazetted Officers of State or Central Government.

4. PROPER FILLING UP OF THE PRICE SCHEDULE:

The Bidders should fill up the price schedule (Annexure-V of Section-III) properly and in full. The tender may be rejected if the schedule of price is submitted in incomplete form as per clause-34 (ix) of Section-II of the Specification.

5. NATURE OF PRICE INDICATED IN SPECIFICATION SHALL BE FINAL.

The nature of price indicated in the Clause-13, Section – I of PART –I of the Specification shall be final and binding.